


MITSUBISHI HEAVY INDUSTRIES, LTD. Natural refrigerant CO₂ Heat Pump Water Heater ESA30E series

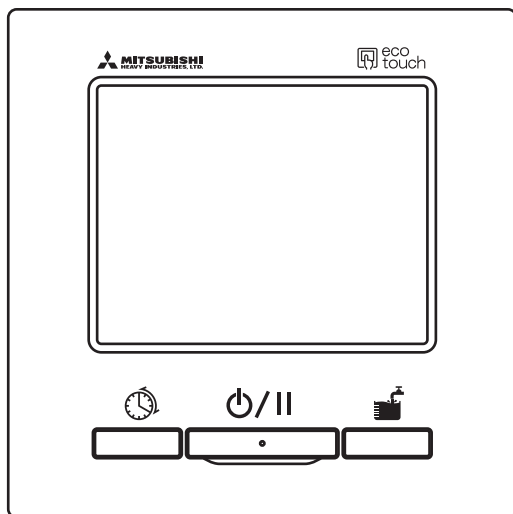

Thank you very much for your purchasing the heat pump water heater for commercial use.

This user's manual describes cautions for safety. Please read this manual carefully before use in order to operate the unit properly.

Keep this manual, after reading, at a safe place where you can consult it whenever it is necessary.

When the ownership of the unit is changed, please be sure to transfer this manual and the "Installation Manual" to a new owner.

It is not recommended for a user to install or move the unit by the user's own discretion. (Safety or functions may not be assured.)

The emission sound pressure level from the heat pump unit is under 70dB (A).

Contents

Note



- In order to protect the heat pump unit, be sure to turn the power on at least 6 hours before starting operation. (Supply the power to the crankcase heater and warm up the compressor) And do not turn the power off when stopping. (During stopping of compressor, the crankcase heater is kept energized for the compressor to be kept warm in order to prevent compressor from breakdown due to the migration of liquid refrigerant in the compressor.)
- If the ambient air temperature becomes below 0°C, the water pipe may freeze. It may cause break of the water pipe and the heat pump unit. Please consult with the dealer and take proper measure for anti-freezing water. If water may freeze, be sure to keep the power turning on during Pause as well. This unit has a function to start anti-freeze operation during Pause, when water may freeze.
- If do not use hot water for one month or more, be sure to shut off the main power and drain off the water in the heat pump unit and the unvented cylinders. When power failure happens and the water may freeze, be sure to drain off immediately. Regarding the way to drain off, please consult with the installer or the dealer.

Before use	2
Safety precaution	2
Component replacement guide for maintenance check and preventive maintenance	10
Water quality criteria.....	11
General description of CO ₂ heat pump water heater ...	12
Description of functions and contents of CO ₂ heat pump water heater ...	14
Names and functions of sections on the R/C ...	16
Screen flow.....	18
Operation method of basic operation	20
Hot water operation method	20
How to Run/Pause	21
Setting of HW temp for the operation to top up	22
Schedule setting	23
How to set operation pattern	24
How to set day off	27
How to set peak-cut	29
How to check operation pattern	32
How to do the [Operation to fill up].....	33
How to set to increase or decrease the hot water amount uniformly.....	34
Display usage of hot water amount	35
Display of operation mode	35
Operation method of menu manipulation	36
Limited items for sub remote control	36
How to operate on the menu screen	37
How to operate on the menu screen	38
Notabilia for each setting screen	38
Operation method of various settings	39
How to set [Initial settings]	39
How to set Administrator settings	42
How to check the remote control setting	49
For maintenance	50
Maintenance of remote control, heat pump unit and hot water storage unit ...	50
Measure for anti-freeze water in winter.....	51
When stopping the unit for long period	51
When power failure occurs	51
When error happens	52
Notice of next service date	56
When the [Periodical check] is displayed	57
After-sales Service	57
Specifications	58
EC DECLARATION OF CONFORMITY.....	59






Before use

Safety Precautions

- Please read the precautions written here carefully to operate the unit properly. You are required to observe these fully because every item of these instructions is important for safety.

 WARNING	Failure to follow these instructions may result in serious consequences such as death, severe injury, etc.
 CAUTION	Failure to follow these instructions may cause injury, property damage or, serious consequences depending on.

- The following pictograms are used in the text.

	Never do.		Always follow the instructions given.
	Be sure to ground the unit.		Absolutely keep wet hands away.
	Absolutely keep water away.		

- Keep this manual at a safe place where you can consult with whenever necessary. Show this manual to installers when moving or repairing the unit. When the ownership of the unit is transferred, this manual and the “Installation Manual” should be given to a new owner.
- Electrical wiring work must be implemented only by qualified specialists.

Precautions for installation

WARNING






Consult your dealer or a professional contractor to install the unit.

Be sure to use the genuine optional parts specified by MHI.

Improper installation made on your own may cause electric shocks, fire or dropping of the unit.



⚠ WARNING

<p>Consider measures not to exceed the critical concentration of refrigerant in the event of leakage especially when the unit is installed in a small room. Regarding the measure not to exceed the critical concentration, please consult with our dealer.</p> <p>If the refrigerant leaks and exceeds the critical concentration, it may cause oxygen deficiency accident.</p>	
<p>Take care to protect terminal connections from external forces or stress caused by wiring.</p> <p>Improper connection or fixing could cause heat generation, smoke or fire.</p>	
<p>The maximum voltage connectable to the remote control is DC 18 V. Do not connect to AC220~240V or 380/415V.</p> <p>It could cause breakage, ignition or fire.</p>	
<p>Do not operate HP unit or remote control whose panel or cover is kept opened.</p> <p>Operation with the electric live part kept opened may cause electric shocks, fire.</p>	
<p>The unit should not be used in inappropriate environment.</p> <p>Using the unit at the following places could deteriorate its performance significantly or cause electric shocks, breakdown, smoke or fire as a result of corrosion.</p> <ul style="list-style-type: none"> · Where air contains dense oil mist, steam, organic solvent vapor, corrosive gas (ammonium, sulfuric compound, acid etc) · Where acidic or alkaline solution, cosmetics, special spray, etc. are used frequently · Where oil mist generates · Where dense cigarette smoke exists · Where dust floats in air · Where water vapor generates or heavily humid area · Where inflammable gas may generate, flow in. accumulate or leak · Where cosmetics or special spray is used. 	

⚠ WARNING

Grounding work shall be done securely.

Do not connect the grounding wire to a gas pipe, a water pipe, a lightening rod or a earth wire of telephone
Improper grounding may cause, malfunction or electric shocks at electric leak.



The earth leakage breaker should be installed

If the earth leakage breaker is not installed, it may cause electric shocks.

Please ask the dealer where you purchased it or the qualified specialist who installed it.



The remote control should not be installed where it is exposed to direct sunlight or the ambient temperatures become higher than 40°C or lower than 0°C.

It could cause deformation, discoloration or break-down.



⚠ CAUTION

The drain pipe work shall be done in order for the drain water to drain off without fail.

Improper drain pipe work may cause getting the household goods wet in flooded water or failure of heat pump unit due to blockage of drain water.













Install the remote control on a place which can endure its weight sufficiently.

In sufficient strength or improper installation could cause the remote control to drop off.












■ Precautions for usage

⚠ WARNING	
<p>Avoid using combustible substances (hair spray, insecticide, etc) near the unit.</p> <p>Do not use benzene or paint thinner to clean the unit. It could cause cracks, electric shocks or fire.</p> <p>Stop operation under abnormal situation. If continued, it could result in break-down, electric shocks, fire, etc. If any abnormal condition (burnt odor etc.) occurs, stop operation, turn off the power switch and consult your dealer.</p>	 
<p>Stop operation when any anomaly is detected. If operation is continued, it could cause fire or break-down. Consult you dealer.</p>	
<p>Do not use any liquid except clean water. It may cause fire or explosion.</p>	
<p>Do not touch the hot water pipe with bare hands in order to check the hot water temperature. It may cause a scald.</p>	
<p>Do not change setting or cancel the protection device. Change setting or cancelation of protection device may cause fire, electric shocks or injury.</p>	
<p>When using the unit together with combustion appliance, be sure to ventilate frequently. Insufficient ventilation may cause oxygen deficiency accident.</p>	
<p>Do not insert your fingers or any sticks into the air outlet port of the fan. Since the fan rotates at high speed inside, it may cause injuries. Even if the fan is stopping, it may suddenly start operation.</p>	

⚠ CAUTION	
<p>Do not use or let use the unit or remote control as play equipment. Improper operations could cause ill health or health disorder.</p>	
<p>Never disassemble the remote control. If you touch internal parts accidentally, you could get electric shocks or cause trouble. Consult your dealer when it is necessary to inspect its interior.</p>	

⚠ CAUTION	
Do not wash the remote control with water or liquid. It could cause electric shocks, fire or break-down.	
Do not touch electric parts or operate buttons or screens with wet hands. It could cause electric shocks, fire or break-down.	
Be sure to stop operation and shut down the circuit breaker before starting maintenance work. It could cause electric shocks or injury.	
The cleaning of the inside of cylinder shall not be done by yourself. Please consult with the dealer where you purchased it Cleaning with improper selection of detergent or improper usage way may cause damage of the section coated with resin or leakage. And if the detergent splashes on the electric part or motor, it may cause failure, smoke or fire.	
Do not use the base frame for installing unit which is corroded or damaged after long term use. If leaving it corroded or damaged, it may cause a fall of the unit or injury.	
Do not ride on the unit or put something on the unit. It may cause falling or turnover.	
Do not put anything which will be troubled by getting wet under or near the unit. If dew condenses on the unit, refrigerant pipe or water pipe or drain water sticks depending on the operation state, it may be damaged by dropping water.	
Do not put anything such as a vase filled with water on the unit. It may cause electric shocks, ignition or malfunction of the unit.	
Do not put anything or not pile up fallen leaves around the unit. If there are fallen leaves, insects may intrude in the unit. And if they touch the electrical components inside of the unit, it may cause malfunction of the unit, ignition or smoke.	

⚠ CAUTION

Do not touch the aluminum fin of the heat exchanger with bare hands If touching, it may cause injury.	
Do not use benzene, paint thinner, wipes etc. to clean the remote control. It could discolor or break-down the remote control. Wipe it with a piece of cloth which is squeezed tightly after wetting with diluted neutral detergent. Finish up the cleaning by wiping with a piece of dry cloth.	
Do not pull or twist the cable of the remote control. It could cause break-down.	
Do not use the unit for special use such as preservation of foods, animals, plants, precision apparatuses and art objects. It may cause deterioration in quality of stores.	
Be sure to use only the fuse with proper capacity. If steel wire or copper wire is used, it may cause malfunction of the unit or fire.	
Do not make the unit run or stopped with power switch. It may cause fire or water leak. And if the auto-restart function is set [Valid], it may cause injury by sudden rotation of the fan.	
Do not use the water for drinking It may affect the health.	
Do not leave the water piping filled with water, when stopping the unit for long period. It may cause deterioration of the water quality or malfunction of the unit due to freezing water. Please shut off the power of the unit and drain off.	
Do not shut off the power. It may cause malfunction of the unit due to freezing water. If shutting off the power of the unit, please drain off. If water could freeze due to power failure, shut off the power immediately and drain off.	

⚠ CAUTION

Use clean water conform to the water quality criteria. (Refer to the criteria in page 7)

Deterioration of water quality may cause malfunction of the unit and water leak.







If a solid body, discolored water, impurity or unusual order is found, please ask inspection.



This appliance can be used by children aged from 8 years and above and persons with reduced physical, sensory or mental capabilities or lack of experience and knowledge if they have been given supervision or instruction concerning use of the appliance in a safe way and understand the hazards involved. Children shall not play with the appliance. Cleaning and user maintenance shall not be made by children without supervision.



■ Precautions for relocation or maintenance

 WARNING	
<p>Consult your dealer when moving, disassembling or repairing the unit. Never modify the unit. Improper handling may result in injury, electric shocks, fire, etc.</p>	
<p>If the unit is submerged due to the natural disaster such as flooding or typhoon, please consult with the dealer where you purchased. If starting operation of the unit, it may cause malfunction, electric shocks and fire.</p>	
<p>Do not use any refrigerant other than the specified refrigerant (CO₂). The maximum high pressure is 14MPa. If using the refrigerant which is not specified, it may cause fire or explosion.</p>	
<p>When repairing or inspecting the unit, be sure to stop the unit and shut off the breaker If the power breaker is not shut off, it may cause electric shocks or injury by operating fan.</p>	
<p>When repairing the unit, no one other than the service man must not approach to the unit. It may cause an unexpected risk involving danger.</p>	

Before use

Please implement a periodical maintenance check and a component replacement from a view point of preventive maintenance

In order to maintain the safety and the function of the product, we would like to ask all customers owing this product to have a periodical maintenance and to replace components by our authorized servicing company.

This list shows the contents and the interval of periodical maintenance under the general usage conditions and the rough indication of the time to replace components.

Especially, regarding the timing of component replacement, the actual time for replacement should be decided in consideration of the usage conditions such as water quality, air quality, setting of hot water operating hours and etc.

Concerning the concrete plan of maintenance check, please consult with our dealer.

Since we are preparing some plans of service contract, we would like to recommend you to conclude such service contract.

- The list is base on the condition to operate the unit for 10hours per day with applying night tariff.

	Component	Check point	Inspection cycle (Time/Year)	Estimated time for replacement
Components of refrigeration circuit	Compressor	High pressure, intermediate pressure, low pressure (Is there any big pressure deviation from standard operation data?) Vibration, sound, insulation resistance, loose connection of terminal	1	40,000 hours
	Heat exchanger (Evaporator)	High pressure, intermediate pressure, low pressure, cleanness of fin	1	10 years
	Gas cooler (water heat exchanger)	High pressure, intermediate pressure, low pressure (Is there any big deviation from standard operation data?) Pressure loss of water (Is the pressure loss of heat pump unit excessive?) Discharge pipe temperature (Is the discharge pipe temp. protection control activated frequently?)	1 (*)	10 years (*)
	Solenoid valve	Behavior, leak, clogging (Is the defrost operation activated frequently?, Is the hot water supplying capacity reduced?)	1	10 years
	EEV (Electronic expansionvalve)	Behavior, leak, clogging (Are LP and/or HP protection control activated frequently?, Is the hot water supplying capacity reduced?)	1	10 years
	Strainer	Temp. difference between inlet and outlet ports of strainer (Is there any temperature drop at outlet port of strainer?)	1	At heavy service
	Capillary tube	Contact wear, vibration	1	10 years
Components of electrical circuit	Refrigerant pipe	Contact wear, vibration	1	10 years
	Relay	Behavior, contact resistance at contact point, insulation resistance	1	10 years
	Coil, solenoid (SolenoidValve & EEV)	Insulation resistance	1	10 years
	Crank case heater	Insulation resistance (Is any whitening or carbonizing found?)	1	20,000 hours
	Anti-freezing heater (Drain pan, Water piping)	Insulation resistance (Is any whitening or carbonizing found?)	1	20,000 hours
	Fuse	Apparent condition	1	5 years
	PCB (for Control, Inverterand Water pump)	Apparent condition	1	10 years
	High pressure switch (63H1) Pressure sensors	Contact resistance at contact point Is any rubbing on the capillary tube found?	1	10 years
	Terminal block	Loose connection of terminal	1	10 years
	Wiring and connector	Disconnection, looseness, deterioration, rubbing	1	10 years
	Capacitor	Leakage of electrolysis solution, deformation	1	25,000 hours
	Cooling fan	Insulation resistance, anomalous sound	1	10 years
	Magnet contactor (52C)	Contact resistance at contact point, behavior	1	25,000 hours
	Fan propeller	Balance, crack	1	10 years
Components of water circuit	Fan motor	Insulation resistance, anomalous sound, vibration	1	20,000 hours
	Water pump (DC)	Behavior, vibration, anomalous sound, insulation resistance, water leakage	1(*)	5 years (*)
	Flow regulating valve (CWFV1)	Behavior, vibration, anomalous sound, insulation resistance, water leakage	1(*)	5 years (*)
	Motor valve (CWFV2 to CWFV5)	Behavior, vibration, anomalous sound, insulation resistance, water leakage	1(*)	5 years (*)
	Decompression valve	Behavior, anomalous sound, water pressure, water leakage	1(*)	5 years (*)
	Check valve	Behavior, anomalous sound, water pressure, water leakage	1(*)	5 years (*)
	Strainer	Clogging, water leakage	1(*)	Cleaning 2times/year (*)

* The inspection interval and component replacement interval marked (*) are greatly influenced depending on the water quality to be used. Please consult with our dealer where you purchased for detail.

Water Quality Criteria

Makeup water and cyclic water shall be the water within the range of water quality criteria mentioned below.

If water quality is out of the range of criteria, it may cause a trouble such as scale adhesion and corrosion.

Item			Cyclic water (60°C < ≤ 90°C)	Makeup water
Standard items	pH (25°C)	–	7.0–8.0	7.0–8.0
	Electric conductivity (25°C)	mS/m	≤ 30	≤ 30
	Chloride ion	mgCL ⁻ /L	≤ 30	≤ 30
	Sulphate ion	mgSO ₄ ²⁻ /L	≤ 30	≤ 30
	Acid consumption (pH4.8)	mgCaCO ₃ /L	≤ 50	≤ 50
	Sulphate ion/Acid consumption	–	≤ 0.5	≤ 0.5
	Total hardness	mgCaCO ₃ /L	≤ 70	≤ 70
	Calcium hardness	mgCaCO ₃ /L	≤ 50	≤ 50
	Ionic silica	mgSiO ₂ /L	≤ 30	≤ 30
Reference items	Iron	mgFe/L	≤ 1.0	≤ 0.3
	Copper	mgCu/L	≤ 1.0	≤ 0.1
	Sulphide ion	mgS ²⁻ /L	Not detected	Not detected
	Ammonium ion	mgNH ₄ ⁺ /L	≤ 0.1	≤ 0.1
	Residual chlorine	mgCl/L	≤ 0.1	≤ 0.3
	Free carbon	mgCO ₂ /L	≤ 0.4	≤ 4.0
	Stability index		–	–

Before use

General description of CO₂ heat pump water heater

1. Composition of CO₂ heat pump water heater

This heat pump water heater for commercial use is a heat pump water heater that is composed of a heat pump unit with natural refrigerant such as CO₂ which can produce hot sanitary water with heat pump technology and a hot water storage unit which can store hot water.

A touch panel type remote control is applied to this heat pump water heater for commercial use and various function settings can be done with simple operation.

It is available to operate up to 16 units of heat pump units simultaneously with one remote control.

2. Mechanism of CO₂ heat pump water heater


The way to produce hot water with this heat pump water heater is that the heat energy retrieved from the outdoor air heats up the refrigerant and such refrigerant circulated in the system increases the water temperature.

Therefore, the heating amount to be given to the hot water as heating energy is "[The power consumption of heat pump unit] + [the heat retrieved from the air]".

Accordingly, the consumed energy efficiency becomes more than 1 (one). In other words so that this system allows very high efficiency operation.


Merit of CO₂ refrigerant

- The global warming potential (GWP) is [1] and it is environment-friendly.
- Since high temperature water can be produced efficiently, it is possible to adjust the heat reserving volume by controlling the hot water temperature and to use the hot water for high-temperature cleaning.

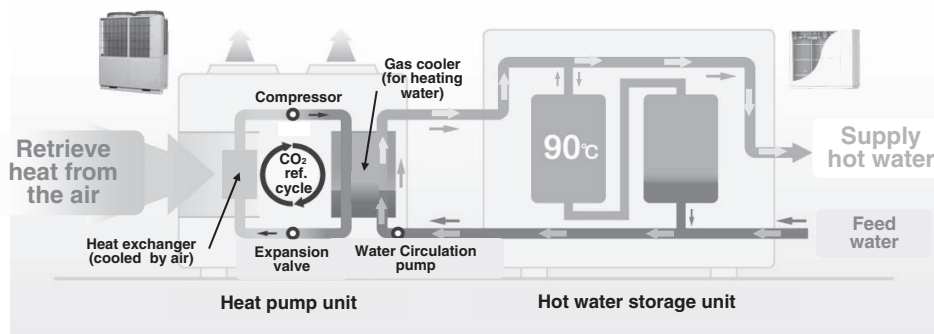

3. Operation pattern of CO₂ heat pump water heater

This heat pump water heater is operated with the target hot water amount set at each set time. The typical operation pattern and setting items are explained with following figure.

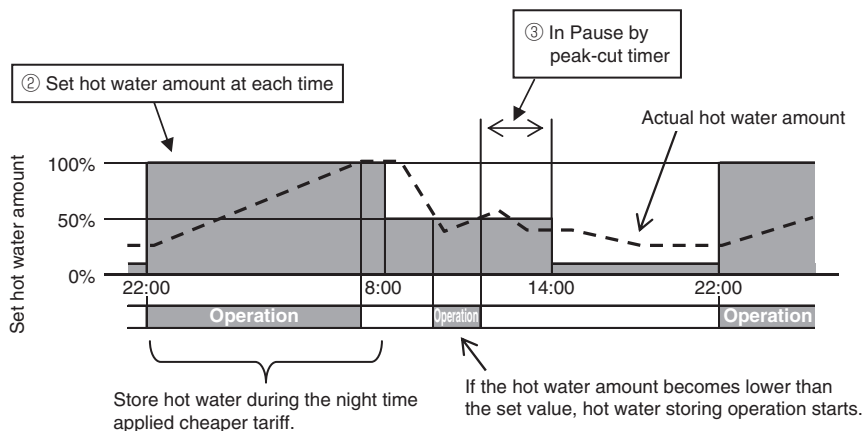

Setting of hot water storage operation (Refer to the setting method in Page 20)

① Hot water temp

Store hot water in the hot water storage unit at the hot water temp set with remote control. The heat reserving volume of the hot water storage unit can be increased or decreased by increasing or decreasing the hot water temp. If multiple heat pump units are connected to one remote control, it is available to set the hot water temp individually.

② Hot water amount at each set time

Hot water amount can be set at each set time with remote control. Set the hot water amount to meet the state of hot water usage.

③ Peak-cut timer

It is available to prohibit or save operation of the heat pump unit at the designated time. The contract amount of power can be reduced by applying peak-cut operation of heat pump unit according to the power demand.

④ Hot water amount setting

The hot water amount at each set time can be increased or decreased uniformly on the day of a week basis. In case that the usage amount of hot water may vary depending on the season or the day of a week, please use this function.

Ex. 1 In summer: More In winter: Less

Ex. 2 From Monday to Thursday: Less Friday, Saturday: More Sunday: Normal

⑤ Setting [Pause]

If it is a day off and no hot water is required to store, it can make hot water storage operation prohibited.

Before use

Description of functions and contents of CO₂ heat pump water heater

The following settings can be done with this remote control.


Regarding the detailed setting methods, please check each function mentioning in reference page.

Setting and display item		Contents	Reference page
Run		The heat pump unit can be started operation. The heat pump unit is operated according to the set operation pattern.	Page 21
Pause		The heat pump unit can be paused operation. The set operation pattern becomes invalid and the heat pump unit does not start hot water storage operation. * Protection operation of heat pump unit (Anti-freeze protection operation) may start.	Page 21
Schedule setting	Setting of weekly operation pattern	Set the operation pattern on the day of a week. ■ Maximum 8 patterns in a day can be set.	Page 24
	Setting of day off	On the day that the hot water storage operation is no necessary such as holiday and day off, it can be set [Day off]. ① Set the day in every week [Day off]. ② Set the [Start day] and the [End day], and set [Day off] through this period. ③ Set the specific day, and set it [Day off].	Page 27
	① Every week ② Specific period of time ③ Specific day		
	Peak-cut timer	Set the [Start time] and [End time] of the operation to limit the capacity and saving rate of capacity. ■ Maximum 4 patterns in a day can be set. ■ From 0% to 80% (at 20% intervals) of the saving rate of capacity can be selected. * The clock setting is required.	Page 29
	Checking of operation pattern	The current operation pattern can be checked.	Page 32
Operation to fill up		The heat pump unit is operated until the hot water storage unit is filled with hot water up to 100%.	Page 33
Setting of hot water temp		Hot water temp can be set.	Page 22
Setting of hot water amount		Hot water storage amount can be increased or decreased uniformly.	Page 34
Display usage of hot water amount		The usage of hot water amount for the selected heat pump unit is displayed. ■ The hot water amount on the last previous day and the present day is displayed. (for maximum 48 hours)	Page 35
Display of operation mode	Display contents on RC		
	· Now stopping	The heat pump unit is stopping The heat pump unit does not start operation	
	· It makes a Pause by switch Run/Pause,	The heat pump unit is stopping by operating [Run/Pause] switch or by the "Day off" setting.	
	· Paused by "Day OFF" setting	The heat pump unit does not start operation but it may start protection operation.	
	· It is in operation by standby	Since the current hot water amount exceeds the target amount, it makes the heat pump unit standby.	Page 35
	· It is in operation to top up	The heat pump unit is in operation to top up.	
	· It is in operation to fill up	The heat pump unit is in operation to fill up.	
	· In operation for anti-freezing	In order to prevent water in the pipe from freezing, the water pump is operating.	

Setting and display item		Contents	Reference page
Display of operation mode	· In operation for defrosting	The defrost operation is ongoing.	Page 35
	· In operation for peak-cut	Peak-cut rate is set.	
	· Standby	It makes the heat pump unit standby for starting operation.	
Initial settings	Clock setting	Current time and date can be set or corrected ■ In case of power failure within 80hours, the clock is kept going by built-in battery for backup. If the period of power failure exceeds 80hours, it is necessary to set clock time again.	Page 39
	Date and time display	On/Off, 12H/24H, display position of AM/PM can be set.	Page 40
	Contrast	The contrast of LCD can be adjusted.	Page 40
	Backlight	On/Off and lighting time of backlight can be set.	Page 41
	Controller sound	On/Off of beep sound at touch panel operation can be set.	Page 41
Administrator settings	Enable/Disable setting	Permission/Prohibition setting of each operation can be set	Page 42
	Night tariff setting	In order to calculate the power consumption in day/night time, the time zone applied night tariff can be set.	Page 43
	HP unit selection	The heat pump unit to be displayed on RC can be selected. * If not selected, RC select a heat pump unit automatically.	Page 43
	RC display setting	RC name and HP unit name can be registered. On/Off of [Defrost operation display] and [Display status of HW amount] can be set.	Page 44
	Step size of HW temp	Step size of HW temp (at 5°C or 1°C intervals) can be set. * Factory default is 5°C.	Page 47
	Change administrator password	Administrator password can be change.	Page 47
	User environment	By selecting the operation pattern of typical business type, the detailed operation pattern can be set easily.	Page 48
Check of RC setting		Current setting list of RC and HP unit can be checked	Page 49
Contact company		Contact company and phone No. are displayed	Page 56

Before use

Names and functions of sections on the R/C (Operating section)

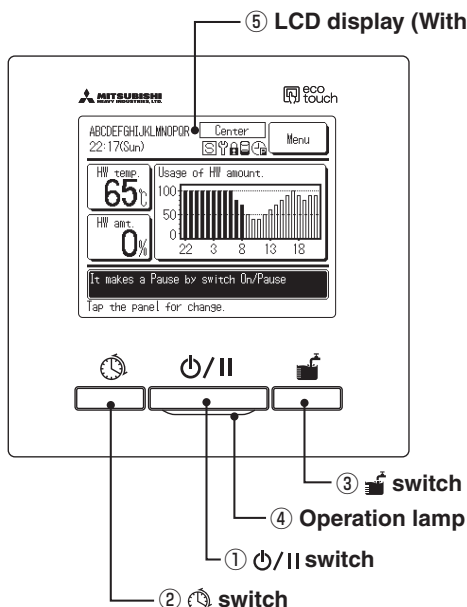

Touch panel system, which is operated by tapping the LCD screen with a finger, is employed for any operations other than the ①Run/Pause, ②Schedule setting and ③Operation to fill up switches.

① ⏻ switch (Run/Pause switch)

One push on the button starts operation and another push pauses operation. (☞ Page 21)

② 🕒 switch (Schedule setting switch)

Pushing this button starts schedule setting. (☞ Page 23)

③ 🚰 switch (Operation to fill up switch)

Pushing this button starts operation to fill up. (☞ Page 33)

④ Operation lamp

This lamp lights in green (yellow-green) during operation. It changes to red if any error occurs.

⑤ LCD (With backlight)

A tap on the LCD lights the backlight.


The backlight turns off automatically if there is no operation for certain period of time.

Lighting period of the backlight lighting can be changed. (☞ Page 42)

If the backlight is ON setting, when the screen is tapped while the backlight is turned off, the backlight only is turned on. (Operations with switches ①, ② and ③ are excluded.)

Names and functions of sections on R/C (Display)

* All icons are shown for explanation.

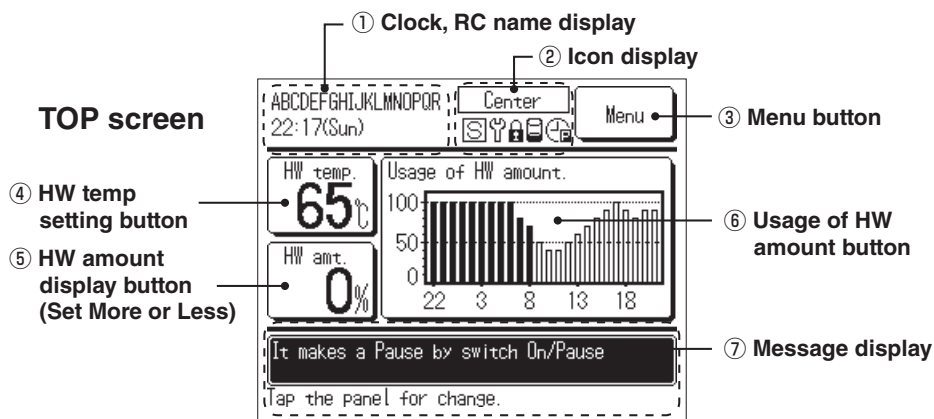

① Clock, RC name display

Display the current time (Page 39) and the name of remote control (Page 44)

② Icon display

Each icon is displayed when one of following setting is going on.

Center



When the central control (optional part) is running

When setting is made from the Sub RC (Page 36)



When the periodical check is required. (Page 53)



When the Enable/Disable setting is made. (Page 42)



When the peak-cut timer is set. (Page 29)



When hot water cannot be stored up to the set HW amount. (Page 46)

③ Menu button

When setting other than the following items ④-⑦, tap the menu button. When menu items are displayed, select one and set it.

④ HW temp setting button (Page 22)

The hot water temp currently set is displayed. When changing HW storage temp, tap this button.

⑤ HW amount display and set button (Page 34)

The current HW amount is displayed. If set HW amount [More] or [Less], tap this button.

* Despite no use of hot water, there is a case that the display of HW amount may decrease. Because the display of HW amount shows the HW temp in the HW storage unit whose temp is 50°C or higher. If leaving hot water for long period without use, HW is getting colder and HW amount is going to decrease. This is not a malfunction.

⑥ Display usage of HW amount (Page 35)

Today's usage of HW amount is displayed. If change the date to be displayed or the HP unit to be displayed, tap this button.


⑦ Message display section (Page 14)

The operation state of HP unit and the message of RC operation is displayed.

Before use

Screen flow

Top screen	
Run/Pause switch	Refer to Page 21
Schedule setting switch	Refer to Page 23
Setting of weekly operation pattern	Refer to Page 24
Setting of day off	Refer to Page 27
Setting of peak-cut	Refer to Page 29
Checking of operation pattern	Refer to Page 32
Operation to fill up switch	Refer to Page 33
Hot water temp setting	Refer to Page 22
Hot water amount setting	Refer to Page 34
Display usage of Hot water amount	Refer to Page 35
Operation mode display	Refer to Page 14
Main menu	
Initial settings	Refer to Page 39
Clock setting	Refer to Page 39
Date and time display	Refer to Page 40
Contrast	Refer to Page 31
Backlight	Refer to Page 41
Controller sound	Refer to Page 41
Administrator settings	Refer to Page 42
Enable/Disable setting	Refer to Page 42
Night tariff setting	Refer to Page 43
HP unit selection	Refer to Page 43
RC display setting	Refer to Page 44
Step size of HW temp	Refer to Page 47
Administrator password setting	Refer to Page 47
User environment	Refer to Page 48
Check of RC setting	Refer to Page 49
Contact company	Refer to Page 56

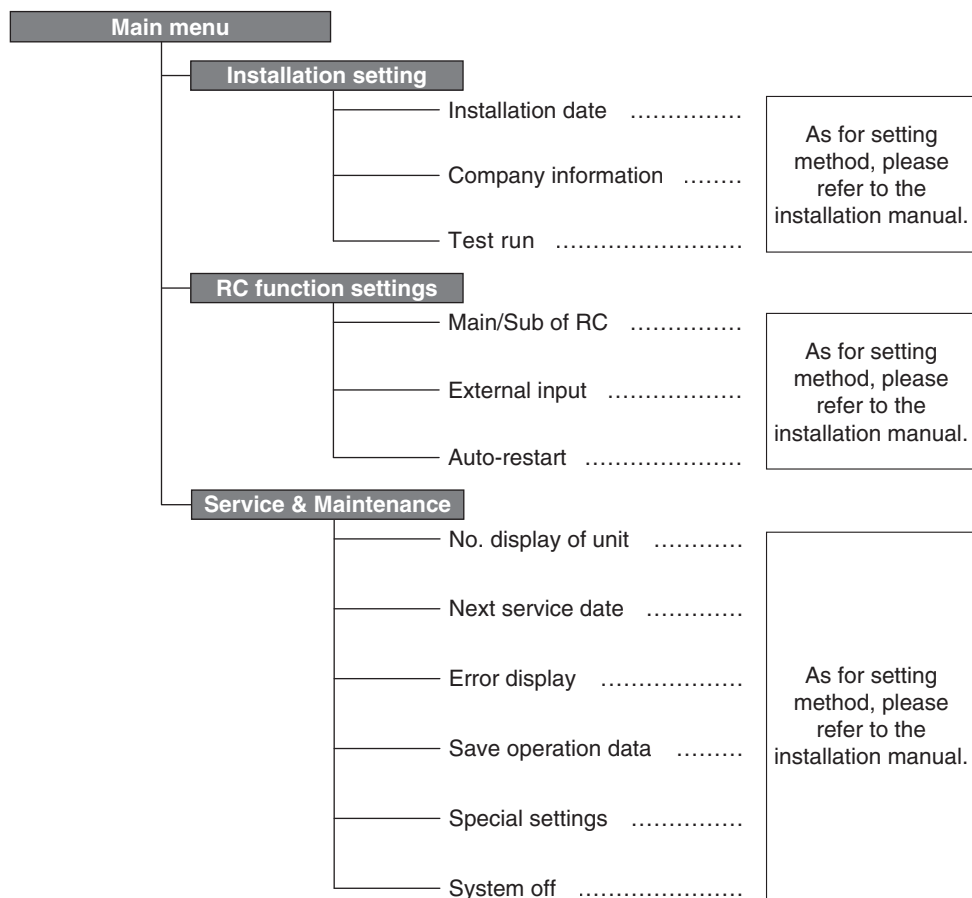

Operation method of basic operation

Hot water operation method



The heat pump unit is operated according to the setting of [Hot water temp], [Target hot water amount at each time zone] and [Hot water amount] set with remote control.

[Explanation of hot water operation method]

If the current HW amount is less than the target HW amount at current time zone, the heat pump unit is operated to top up.

The hot water temp at the operation to top up is the setting value of the hot water temp

(Ex.) In case of the settings shown on the right HW temp : 65°C
Target HW amount: 22:00-100%, 8:00-50%, 14:00-10%

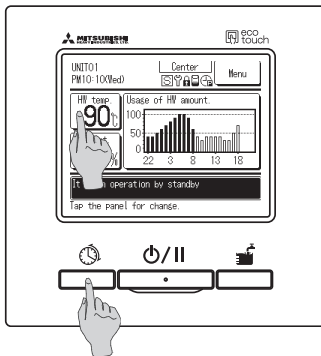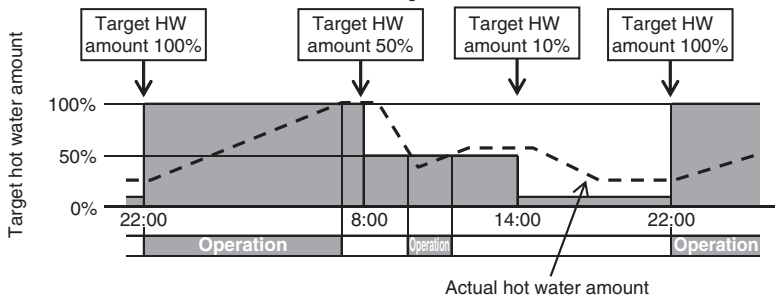

1. HW temp


Tap the **HW temp** button on the TOP screen.

Set the HW temp from the menu of the HW temp setting (☞ Page 22)

2. Target HW amount at each time zone

Push the **Schedule setting** switch.


Set the target HW amount from the menu of the operation pattern setting (☞ Page 23)

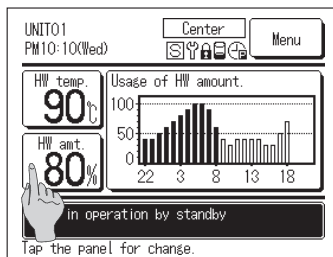

3. HW amount setting

The HW amount set at each time zone can be increased or decreased (from 0.8 times to 1.2 times of HW amount). For change setting, tap the **HW amount** button on the TOP screen and set the HW amount on the [HW amount setting] screen. (☞ Page 34)

How to Run/Pause

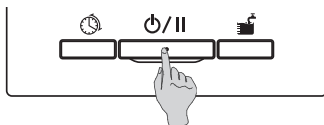


1. Run

When push **Run/Pause** button during pausing, the [Operation acknowledge] screen is displayed.

When tapping **Yes**, it starts operation.

- If the current HW amount is less than the target HW amount, the heat pump unit start operation to top up.





2. Pause

When push **Run/Pause** button during operating, the [Pause acknowledge] screen is displayed.

When tapping **Yes**, it pauses operation.

- In case of Pause, the heat pump unit does not operate to top up.
- The heat pump unit may operate in order to protect itself.

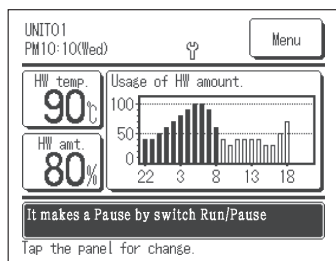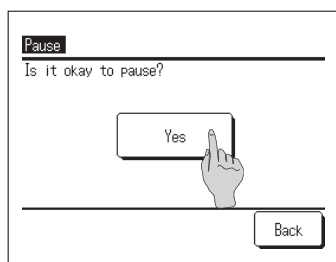

When pausing, each operation button on the screen is lit off. And after the set lighting time of the backlight (Page 41) has been elapsed, the backlight turns off.

When tapping the screen, backlight turns on and each operation button is put the light on.

Information


- There is a case that the message of [Invalid operation] may display, when tapping a button. However, it is not a malfunction. The operation button is set as [Invalid]. (Page 42)
- The first operation after turning the power on, it starts operation according to the following operation conditions. Please change setting according to the hot water heating load requested by the customer.

HW temp	...	65°C
Target HW amount	22:00 to 8:00	100%
	8:00 to 22:00	30%


Operation method of basic operation

Setting of HW temp for the operation to top up

The HW temp for the operation to top up can be set as follows.

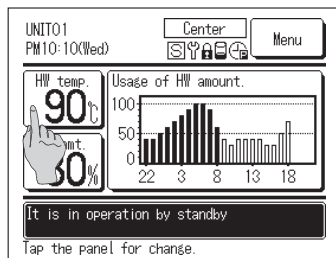


1. Tap the **HW temp** button on the TOP screen.

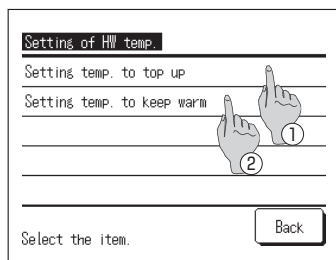

2. The menu screen of the [Setting of HW temp] is displayed. Tap the desired item.


- ① Setting temp to top up
- ② Setting temp to warm up (Out of use)



3. If the multiple heat pump units is connected to the remote control, the list of heat pump units (Address No.) is displayed.

Tap the [HP unit No.] to be set.

Up to 8 units is displayed on the [Select heat pump unit] screen. If 9 or more units are connected, the 9th and the subsequent units are displayed by tapping **Next** button.



4. Set the HW temp by tapping **▲** **▼** buttons and tap **Set** button.

5. The TOP screen is displayed, when tapping **Set** button

■ The HW temp can be set at 5°C intervals.

HW temp setting range: From 60 to 90°C (Factory default: 65°C)

■ If tapping **Back** button without tapping **Set** button, the setting becomes invalid and it returns to the TOP screen.

■ The [Admin password input] screen may be displayed according to the setting of [Enable/Disable setting] (Page 42)


Information

- If the "Unvented cylinder" is connected, the HW temp for the operation to warm up can not be set.
- Actual HW outlet temp may differ about $\pm 3^{\circ}\text{C}$ from the set HW temp by the operating conditions.


Schedule setting

The operation schedule of the heat pump unit can be set.

The setting of target HW amount at each time zone, the setting of day off and setting of peak-cut can be set.

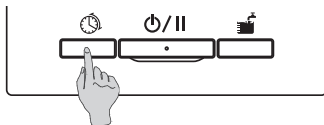

1. Push the **Schedule setting** switch on the panel.



2. The menu screen of [Setting of schedule] is displayed.
The summary of each menu item is as follows

- ① Setting of weekly operation pattern (To 3)
- ② Setting of day off (To 4)
- ③ Setting of peak-cut (To 5)
- ④ Checking of operation pattern (To 6)

3. Setting of weekly operation pattern (See page 24 for detail)

The target HW amount at each time zone for each day can be set.

The operation pattern can easily be set from the setting of User environment (Page 48)

4. Setting of day off (See page 27 for detail)

By setting day off, the heat pump unit operation to top up can be invalid on the day set day off.

It is available to set day off ①Every week ②Specific period of time ③Specific day.

5. Setting of peak-cut (See page 29 for detail)

By limiting the maximum capacity of the heat pump unit, the power consumption can be reduced.

It is available to set on weekly basis.


6. Checking of operation pattern (See page 32 for detail)

The current operation pattern can be checked.


Operation method of basic operation

How to set operation pattern


The target HW amount at each time zone for each day can be set.

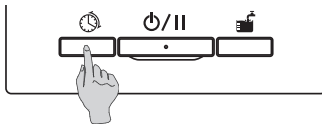

1. Push the **Schedule setting** switch on the panel.

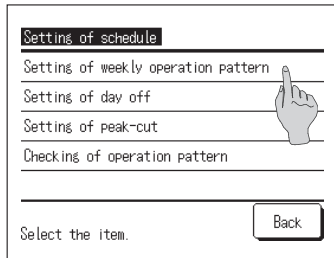


2. The menu screen of [Setting of schedule] is displayed.
Tap the [Setting of weekly operation pattern]

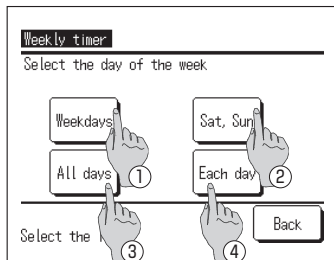

3. The selection screen of [Weekly timer] is displayed.
Tap the item of setting day.

- ① Weekdays: From Monday to Friday
 - ② Sat, Sun: Saturday and Sunday
 - ③ All days: From Monday to Sunday
 - ④ Each day: Go to the [Day selection] screen (⌂ Go to 4)
- } (⌂ Go to 6)



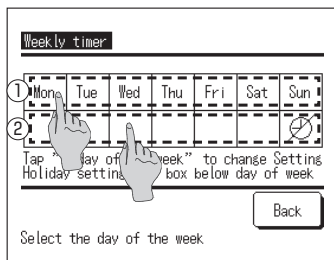


4. Tap the day to be set on the display ①.
The current setting contents of the day tapped are displayed.
(⌂ Go to 6)

5. For the setting day off, tap the blank column on the display ② just below the day.

Switch it Day off: [(off)] ⇔Release: [(blank)]

On the day set day off, the hot water storage operation is not done. Multiple selections of day off settings are available.

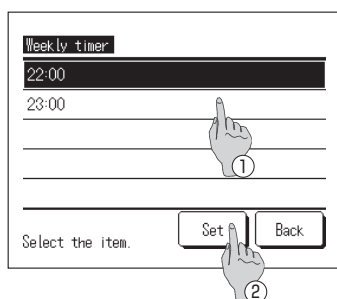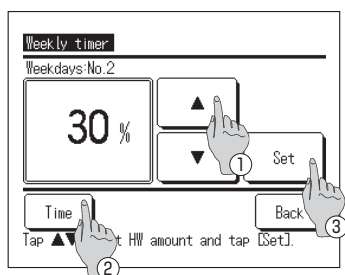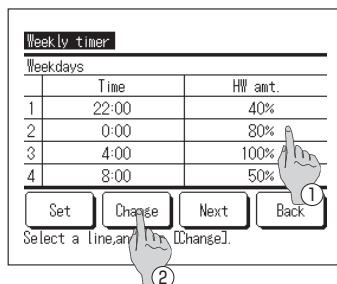

6. The [Checking of operation pattern] screen is displayed.

When changing the setting contents, ① select the column of the setting No. to be changed ② and tap **Change** button.

■ The setting contents displayed at first may differ depending on the set day selected (☞ Go to 3)

- ① Weekdays: Set operation pattern on Monday
- ② Sat, Sun: Set operation pattern on Saturday
- ③ All days: Set operation pattern on Monday
- ④ Each day: Set the operation pattern on the day selected

7. The [HW amount] setting screen is displayed.

- ① Set the HW temp by tapping **▲** **▼** buttons (at 10% intervals)
- ② The setting time can be changed by tapping **Time** button (☞ Go to 8)
- ③ When tapping **Set** button, the time is set and it return to the [Checking of operation pattern] screen.

8. The [Set time selection] screen is displayed.

- ① Select the time to be set
- ② When tapping **Set** button, the time is set and it return to the [Checking of operation pattern] screen. (☞ Go to 9)

■ If changing the set time of weekdays, select the [Weekdays] (☞ Go to 3) and change the time.

■ Time setting range

The time can be changed within the range show in following table.


	Default setting	Setting range
1	22:00	22:00, 23:00
2	0:00	from 0:00 to 3:00
3	4:00	from 4:00 to 7:00
4	8:00	8:00, 9:00
5	10:00	from 10:00 to 12:00
6	13:00	from 13:00 to 15:00
7	16:00	from 16:00 to 18:00
8	19:00	from 19:00 to 21:00

Operation method of basic operation

Weekly timer

Weekdays	Time	HW amt.
1	22:00	40%
2	0:00	80%
3	4:00	100%
4	8:00	50%

Select one, and tap [Change].



9. [Checking of operation pattern] screen is displayed

When saving the setting, tap button.

① In case of setting all

It shifts to the [Set all contents acknowledge] screen

(➡ Go to 10)


② In case of individual setting

Save the setting and shift to the [Day selection] screen

(➡ Go to 4)

Weekly timer

Do you want to apply group setting?



10. [Set all contents acknowledge] screen is displayed

Tap and save the setting

After saving, it returns to the [Day selection] screen

11. If the setting is done by changing the day, please start setting from 4.

Notabilia

By applying 9 sensors on the cylinder at installation, it is available to control the HP unit for the operation to store hot water or for the operation to top up at 10% intervals of HW amount.

In case that 9 sensors can not be applied on the cylinder, the unit cannot detect HW amount at 10% intervals and it can detect only the preset HW amount shown in following table depending on the applying number of sensors.

The position to apply temp sensor according to the hot water amount %

Number of sensors to apply								Recommendable
Sensor No.	3pcs	4pcs	5pcs	6pcs	7pcs	8pcs	9pcs*1	
Tht-1	20%	20%	20%	10%	20%	10%	10%	
Tht-2	60%	50%	40%	30%	30%	20%	20%	
Tht-3	100%*2	75%	60%	40%	40%	30%	30%	
Tht-4		100%*2	80%	60%	50%	50%	40%	
Tht-5			100%*2	70%	65%	60%	50%	
Tht-6				100%*2	80%	70%	60%	
Tht-7					100%*2	80%	70%	
Tht-8						100%*2	80%	
Tht-9							100%*2	

*1 Recommendable number of sensors is 9pcs.

If the number of sensors is less than 9pcs, the hot water amount cannot be detected correctly.

*2 The sensor which detects 100% of HW amount shall be applied to the position within the range of sensitive volume with consideration of dead volume which is 10% of total volume of cylinder.

However, HW amount can be set at 10% intervals arbitrarily with RC despite of the number of sensors applied. Therefore, in such case, please take note that the unit may not be controlled for the operation to store hot water or for the operation to top up according to the set HW amount you intended.

Ex) In case of applying 3 sensors on the cylinder.


Heat pump unit can detect only 20%, 60% and 100% of HW amount in the cylinder.

Therefore, even though 80% of HW amount is set with schedule setting, the HP unit cannot stop at storing 80% of HW amount and it still keeps on operating until storing 100% of HW amount.


And if 40% of HW amount is set for the operation to top up, HP unit cannot start operation to top up until HW amount decreases to 20%.

How to set day off


The day off for ①Every week ②Specific period of time ③Specific day can be set.
If the day set day off, the operation to top up on that day is not done.

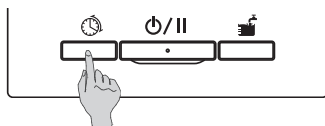

1. Push the **Schedule setting** switch on the panel.

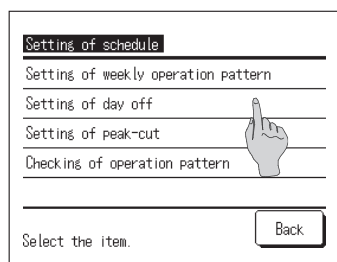


2. The menu screen of [Setting of schedule] is displayed.
Tap the [Setting of day off]

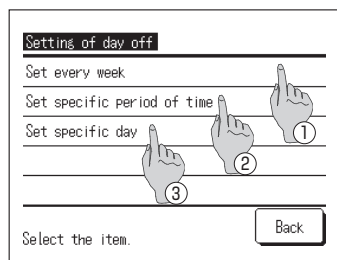

3. The menu screen of [Setting of day off] is displayed.
Tap the desired period.


- ① Set every week (☞ Go to item 5 on Page 24)
- ② Set specific period of time (☞ Go to 4)
- ③ Set specific day (☞ Go to 8)

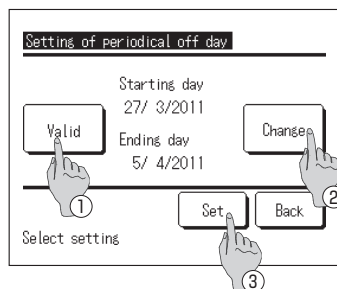

4. The detail screen of [Setting of periodical off day] is displayed.

- ① Switch the setting [Valid] ⇔ [Invalid].
by tapping **Valid/Invalid** button
- ② If changing the set contents, tap **Change** button.
(☞ Go to 5)
- ③ When tapping **Set** button, the contents are saved
and return to the TOP screen.


■ Operation method of basic operation

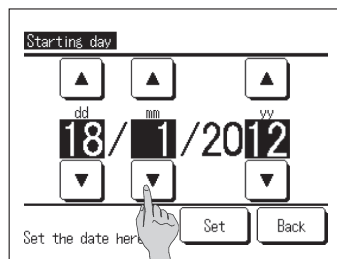

5. Set the [Starting day].

Set the dd/mm/yy by tapping ▲ ▼ buttons.

After setting the date, tap **Set** button.

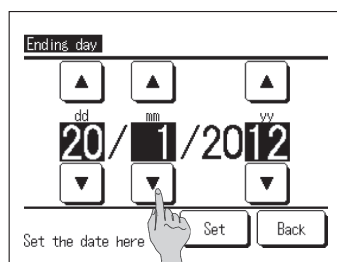


6. Set the [Ending day].

Set the dd/mm/yy by tapping ▲ ▼ buttons.

After setting the date, tap **Set** button.


7. The [Checking of set contents] screen is displayed (☞ Go to 4)

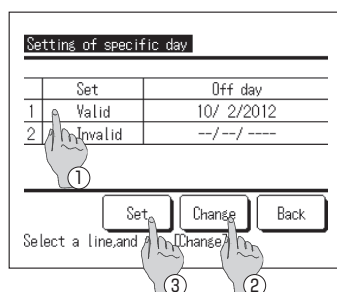

8. The detail screen of [Setting of specific day] screen is displayed.

If changing the set contents, ① select the line of setting No. and ② tap **Change** button. (☞ Go to 10)

9. ③ When tapping **Set** button, the set contents are saved and it returns to the TOP screen.

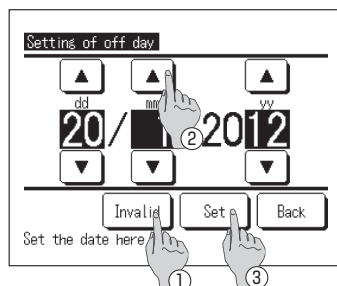

10. Set the [Setting of day off].


① Tap **Valid/Invalid** button and switch the setting [Valid] ⇔ [Invalid]

② Set the dd/mm/yy by tapping ▲ ▼ buttons.


11. ③ When tapping **Set** button, the detail screen is displayed. (☞ Go to 8)

How to set peak-cut


Peak-cut on weekly basis can be set

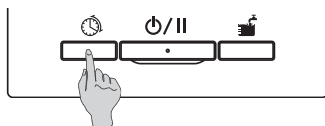

1. Push the **Schedule setting** switch on the panel.

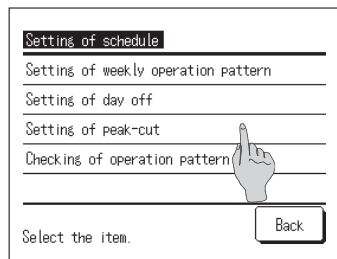


2. The menu screen of [Setting of schedule] is displayed.
Tap the [Setting of peak-cut]

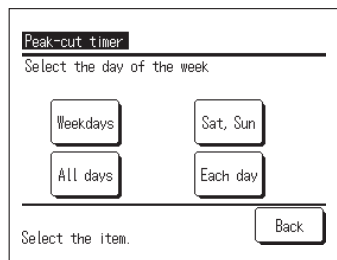

3. The selection screen of [Peak-cut timer] is displayed.
Tap the item of setting day.

- ① Weekdays: From Monday to Friday
 - ② Sat, Sun: Saturday and Sunday
 - ③ All days: From Monday to Sunday
 - ④ Each day: Go to the [Day selection] screen
- } (Go to 6)
- (Go to 4)

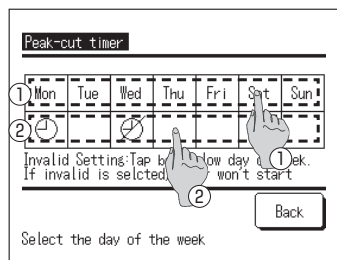

4. Tap the day to be set on the display ①.

The current setting contents of the day tapped are displayed (Go to 6)


5. For the setting Valid/Invalid, tap the blank column on the display ② just below the day.

Switch Valid : [☑] ⇔ Invalid [☒]

On the day set invalid, the peak-cut operation is not done.

Multiple selections of invalid settings are available.


■ Operation method of basic operation

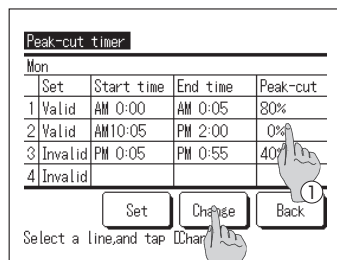

6. The [Checking of current set contents] screen is displayed.
When changing or adding the setting contents, ① select the column of the setting No. to be changed ② and tap **Change** button.


■ The setting contents displayed may differ depending on the set day selected (☞ Go to 3)

- ① Weekdays: Set peak-cut on Monday
- ② Sat, Sun: Set peak-cut on Saturday
- ③ All days in a week: Set peak-cut on Monday
- ④ Each day: Set peak-cut on the day selected

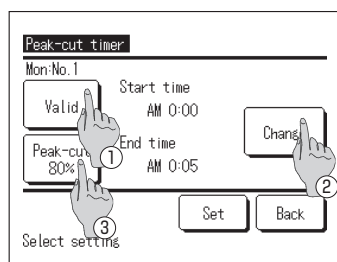

7. The detail screen of [Timer set contents] is displayed.


- ① Switch the setting [Valid] ⇔ [Invalid] by tapping **Valid/Invalid** button
- ② Tap **Change** button. and set [Start time] and [End time]. (☞ Go to 8)
- ③ When tapping **Peak-cut %** button, the [Peak-cut %] can be set. (☞ Go to 10)

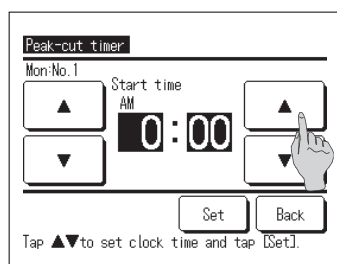

8. Set the [Start time].

Set the Hour/Minute by tapping **▲** **▼** buttons.
The [Start time] can be set at 5-minute intervals


After setting the time, tap **Set** button. (☞ Go to 9)

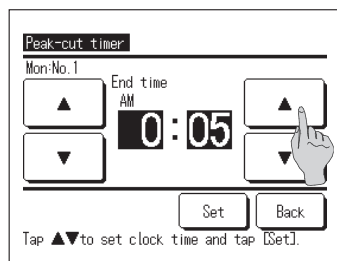

9. Set the [End time].

Set the Hour/Minute by tapping **▲** **▼** buttons.
The [End time] can be set at 5-minute intervals from 5 minutes after the [Start time] up to 24:00.

After setting the time, tap **Set** button. (☞ Go to 11)

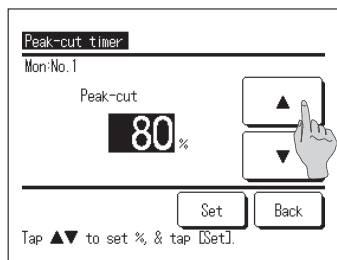


10. Set the [Peak-cut %].

Set the [Peak-cut %] by tapping buttons.
The [Peak-cut %] can be set at 10%, 40%, 60% and 80%.

After setting the [Peak-cut %], tap button.

(☞ Go to 11)

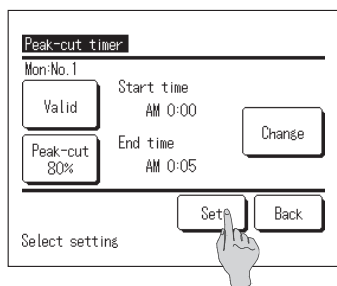


11. The [Checking of set contents] screen is displayed

(☞ Go to 7)

When tapping button, the set contents are confirmed and [Checking of set contents on the day] screen is displayed. (☞ Go to 6)

12. If changing or adding the setting contents on the same day continuously, please start the work from 6.

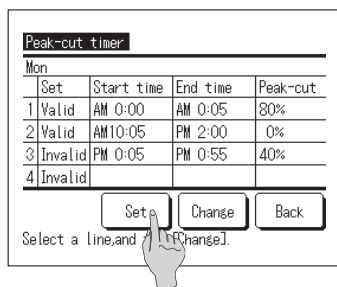

13. The [Checking of setting contents] on the day is displayed. (☞ Go to 6)

When saving the setting, tap button.

① In case of setting all

It shifts to the [All set contents acknowledge] screen
(☞ Go to 14)


② In case of individual setting

Save the setting and shift to the [Day selection] screen (☞ Go to 4)

14. [All set contents acknowledge] screen is displayed

Tap and save the setting

After saving, it returns to the [Day selection] screen

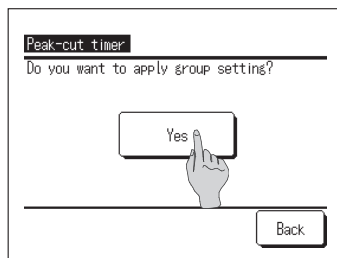


15. If the setting is done by changing the day, please start setting from 4.


Operation method of basic operation

How to check operation pattern


The current operation pattern can be checked

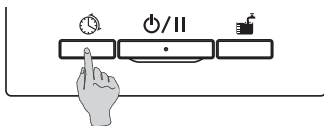


1. Push the **Schedule setting** switch on the panel.



2. The menu screen of [Setting of schedule] is displayed.
Tap the [Checking of operation pattern]

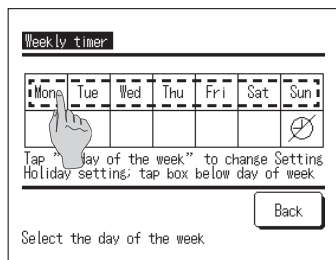

3. Tap the day to be set on the display.
The current setting contents of the day tapped are displayed.

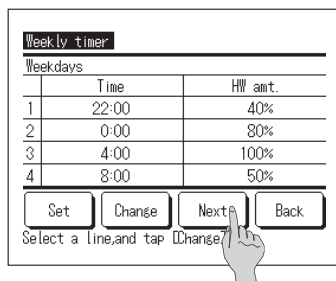


4. The [Checking of set contents] screen is displayed.
When tapping **Next** button, the next setting content is displayed.

If changing the set contents, check the [Way to set operation pattern] (Go to 6 on Page 25)

How to do the [Operation to fill up]

Until the hot water amount becomes 100%, the heat pump units are operated.

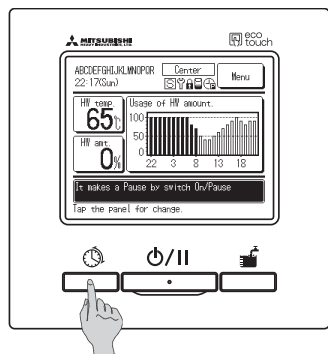


1. Start operation


When pushing [Operation to fill up] switch, the [Acknowledge for operation to fill up] screen is displayed.

■ If it is pausing by pushing [Run/Pause] switch, the [Operation to fill up] cannot be started.

After starting operation by pushing [Run/Pause] switch, push [Operation to fill up] switch.

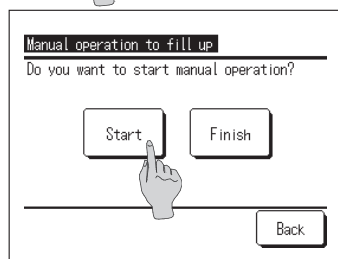

2. When tapping [Start] button, the [Operation to fill up] starts and the TOP screen is displayed.

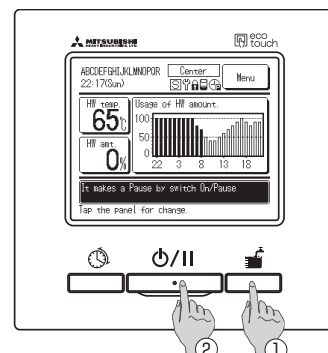


3. End operation

The heat pump unit keeps operation, until the [Operation to fill up] becomes end.

However the [Operation to fill up] can be interrupted with following procedure.

- ① Push [Operation to fill up] switch and tap [Finish] button on the [Operation to fill up acknowledge] screen. (Go to 4)
- ② Make the operation in Pause by pushing [Run/Pause] switch.

■ Even if the setting becomes [Pause] during [Operation to fill up] due to [Setting of day off], the [Operation to fill up] is kept on.

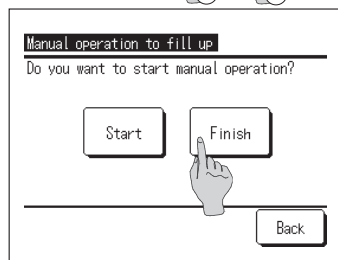


4. When tapping [Finish] button on the [Acknowledge] screen, the [Operation to fill up] finishes and it returns to the TOP screen.


Operation method of basic operation

How to set to increase or decrease the hot water amount uniformly

In case that the usage amount of hot water may vary depending on the season or the day of a week, the hot water amount set by [Setting of operation pattern] can be increased or decreased uniformly.

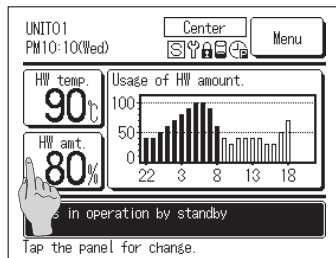

1. Tap **HW amount** button on the TOP screen.




2. The current hot water set amount is displayed.

3. When changing the setting, tap the [] section just below the day to be changed and change the hot water amount. The display changes as follows by every tapping.

Blank (Usual) \Rightarrow More (1.2 time) \Rightarrow Less (0.8 time)

After setting, return to the TOP screen by tapping **Back** button.

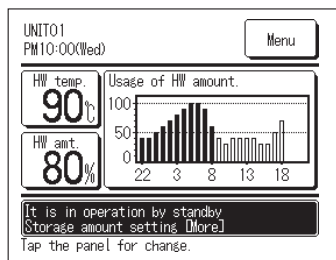


4. When setting [More] or [Less], the set result is displayed at the message display section on the TOP screen.

■ In case of [Usual] (not set to increase or decrease), the message is not displayed.

Note


- If selecting [Usual], the HW amount set with [Operation pattern setting] is target amount. The default setting is [Normal] on all days.
- If selecting [More] or [Less] set with [Operation pattern setting], it makes the target amount [1.2 time] or [0.8 time] of the [Usual] amount uniformly.
- If target HW amount after increasing or decreasing may exceed the maximum or minimum limit, the set amount becomes the max. or min. value. (Max value: 100%, Min value: 10%)

(Ex) In case that the set HW amount is to be [Less]

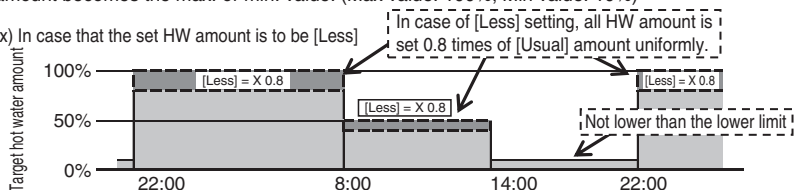

Display usage of hot water amount

Today's usage of hot water amount is displayed on the TOP screen. And the storage amount of hot water by connected each heat pump unit from yesterday up to now can be checked.

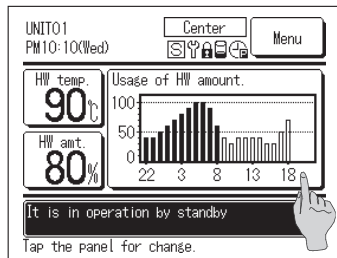


1. The usage of hot water amount per hour is displayed at the [Usage of HW amount] display section on the TOP screen.

2. If displaying the [Usage of HW amount] on yesterday, or switching the heat pump unit to be display, tap the [Usage of HW amount] section.

3. The [Display usage of HW amount] screen is displayed.

① Tap **Yesterday** button and display the [Usage of HW amount] of yesterday. (Go to 4)

② Tap **HP address** button and select the HP unit to be displayed. (Go to 5)

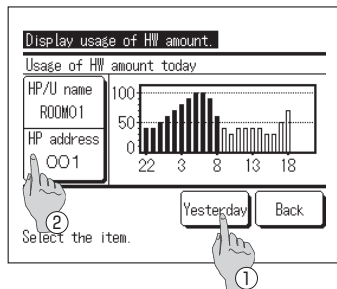


4. The [Display usage of HW amount] screen of yesterday is displayed.

① Tap **Today** button and display the [Display usage of HW amount] of today.


5. The selection screen of heat pump unit is displayed.

Tap **HP unit No.** button to be displayed and the [Usage of HW amount] of selected HP unit is displayed.

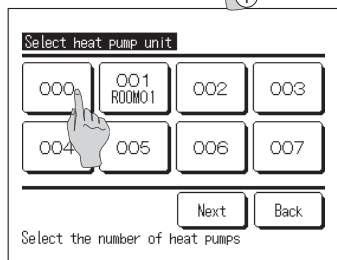

Display of operation mode


The operation mode of the heat pump unit is displayed at the message section on the TOP screen. Regarding the details of the operation mode, please refer to Page 10.

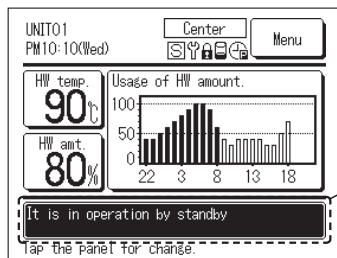


Message display section

Operation method for menu manipulation

Limited items for Sub remote control

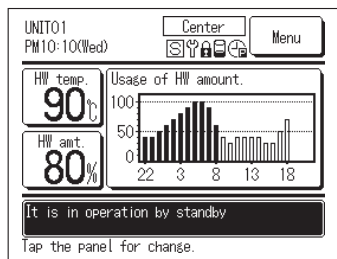


When controlling one heat pump unit with two remote controls, following settings cannot be done with Sub remote control. Please set them with Main remote control.


In case of setting with Sub remote control, the icon  is displayed on the TOP screen.

- Setting of HW temp
- Setting of HW amount
- Setting of schedule
- Administrator settings
- More information

How to operate on the menu screen

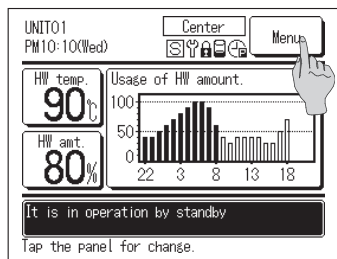


1. Tap **Menu** button on the TOP screen

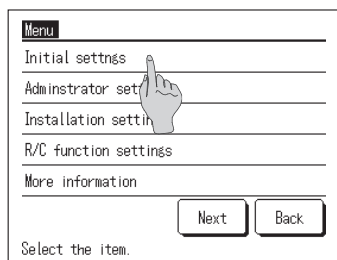


2. The [Main menu] screen is displayed.

When tapping the desired menu item, the setting screen for each item is displayed.

If there are multiple pages, the **Next** button on the first page and the **Previous** button on the last page are displayed.

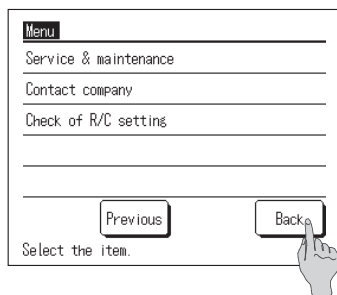

3. When tapping **Back** button, it returns to the TOP screen.

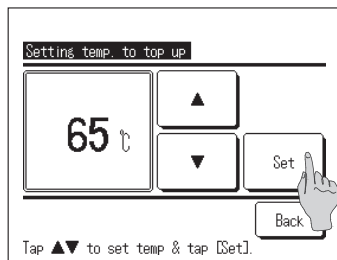

4. On the setting screen of each item, if the **Set** button is placed, the setting content can be confirmed by tapping **Set** button.

Operation method for menu manipulation

How to operate on the menu screen

Input password

Input the administrator password.

0 1 2 3 4 Delete

5 6 7 8 9 Set

Back

Input 4 digit number & tap [Set]

5. Regarding the item mentioning Administrator password in the user's manual, when selecting such item, the [Input Administrator password] screen is displayed. Enter the administrator password (4 digits number) and tap [Set] button.

If the administrator password is unknown or wrong, the setting cannot be changed.

Note


- For the administrator password which is set at the shipping from the factory, refer to the installation manual.
- When your administrator password is forgotten, initialize the password by referring to the installation manual.

Notabilia for each setting screen


- When returning to each following screen from the setting screen, please operate following button or switch.
 - When returning to the main menu screen Tap [Menu] button
 - When returning to the previous screen Tap [Back] button
 - When returning to the TOP screen Tap [Run/Pause] button
- If tapping [Back] button without tapping [Set] button on the way of setting, the set contents becomes invalid and it returns to the last previous screen. And if pushing [Run/Pause] switch on the way of setting, the set content becomes invalid and it returns to the TOP screen after ending this setting mode.
- If no button operation is done for about 5 minutes on the way of setting each item, it returns to the TOP screen automatically and the content going to set becomes invalid.
- When tapping button, the message of [Operation invalid] may be displayed, but it is not a malfunction. Because the button operation is set [Invalid] by setting limited operation.

Operation method for various settings

How to set [Initial settings]

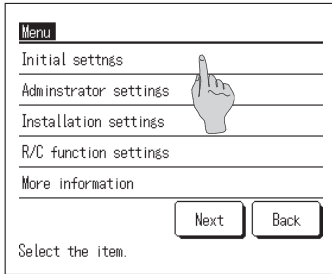


1. Tap the [Initial settings] on the main menu screen.

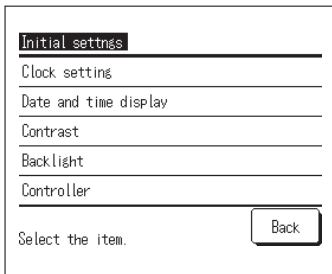

2. The menu screen of [Initial settings] is displayed, tap the desired item.

- | | | |
|-------------------------|-----|---------------|
| ① Clock setting | ... | Go to Page 39 |
| ② Date and time display | ... | Go to Page 40 |
| ③ Contrast | ... | Go to Page 40 |
| ④ Backlight | ... | Go to Page 41 |
| ⑤ Controller sound | ... | Go to Page 41 |


How to set clock time

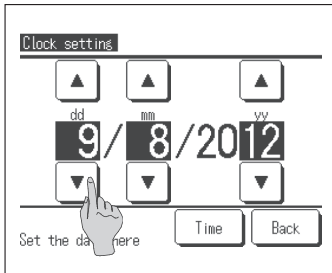

1. Tap the [Clock setting] on the [Initial settings] menu screen, the [Clock setting] screen is displayed.

Set [dd/mm/yy] by tapping ▲ ▼ buttons. After setting, tap [Time] button.

■ Since the hot water storage operation by HP unit is done according to the operation pattern set with the time and date, if the time and date is not set correctly, the hot water storage operation cannot be done correctly.

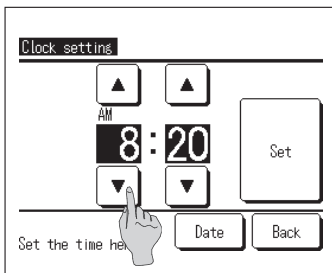


2. Set [Hour : Minute] by tapping ▲ ▼ buttons.

After setting, tap [Set] button.

When change [Date], tap [Date] button.

■ How to set date and time display

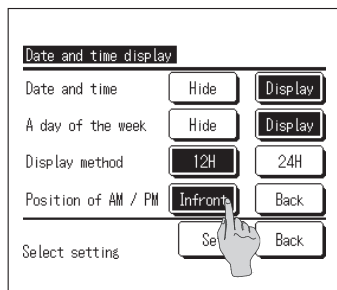

1. When tapping [Date and time display] on the [Initial settings] menu screen, the [Date and time display] screen is displayed.

Set date and time display [Hide] or [Display].

Set a day of the week [Hide] or [Display].

Set the display method

Set [12H]..... In case of 3:50 in the afternoon, it is displayed as [PM 3:50]

Set [24H] In case of 3:50 in the afternoon, it is displayed as [15:50]


Position of AM/PM

Set [Infront] It is displayed as [PM 3:50]

Set [Back] It is displayed as [3:50 PM]

2. After setting each item, tap [Set] button.

■ How to adjust contrast

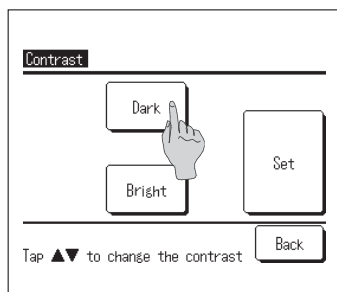


1. When tapping [Contrast] on the [Initial settings] menu screen, the [Contrast] setting screen is displayed. When tapping [Dark] or [Bright] button, the contrast on the screen is changed. Please adjust the contrast as desired.

2. After setting, tap [Set] button.

■ Operation method of various setting

■ How to set backlight

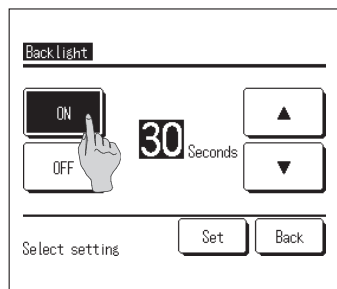


1. When tapping [Backlight] on the [Initial settings] menu screen, the [Backlight] setting screen is displayed. Please set ON/OFF of Backlight and its lighting time (From 5sec to 90 sec at 5-sec intervals).

ON When tapping the LCD, Backlight is lit on.
If no operation is done during the set time period, Backlight is lit off automatically.

OFF Even if tapping the LCD, Backlight is not lit on.

2. After setting, tap Set button.

■ How to set controller sound

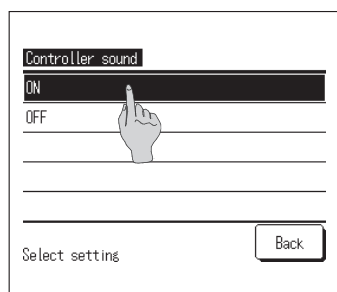


1. When tapping [controller sound] on the [Initial settings] menu screen, the [Controller sound] setting screen is displayed.

Please set ON/OFF of controller sound.

ON When tapping the button on the screen, a “beep” sounds.


OFF No “beep” sounds.

How to set Administrator settings



1. Tap the [Administrator settings] on the main menu screen.


Since Administrator [Input password] screen is displayed enter the Administrator password (→ Go to Page 38)

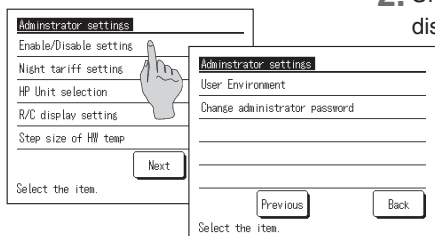

2. Since the [Administrator settings] menu screen is displayed, please tap your desired item.

- | | |
|---------------------------------|-------------------|
| ① Enable/Disable setting | ... Go to page 42 |
| ② Night tariff setting | ... Go to page 43 |
| ③ HP unit selection | ... Go to page 43 |
| ④ RC display setting | ... Go to page 44 |
| ⑤ Step size of HW temp | ... Go to page 47 |
| ⑥ Change administrator password | ... Go to page 47 |
| ⑦ User Environment | ... Go to page 48 |

How to set limited operation

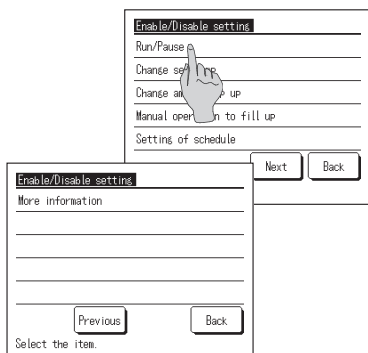

1. When tapping the [Enable/Disable setting] on the [Administrator settings] menu screen, the [Enable/Disable setting] menu is displayed.

Select the following operation items from this menu, and setting of [Operation permission] or [Operation prohibition] is available.


If setting [Permission], operation is available.

If setting [Prohibition], the message of [Operation is invalid] is displayed for 3sec, when operating.

Depending on the operation item, [Administrator password] is required.

The behavior at prohibition setting

- | | |
|-------------------------------|---|
| ① Run/Pause | ... Prohibit Run/Pause operation |
| ② Change set temp | ... Request to enter administrator password at setting change |
| ③ Change amount to top up | ... Request to enter administrator password at setting change |
| ④ Manual operation to fill up | ... Prohibit to start manual operation to fill up |
| ⑤ Setting of schedule | ... Request to enter administrator password at setting change |




2. Tap [Permission] or [Prohibition] on each operation item.

■ Operation method of various setting

■ How to set night tariff


Regarding the power consumption for day time and for night time displayed on the [More information] screen, the time zone to integrate power consumption can be changed.

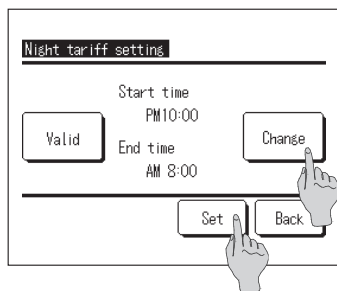

1. When tapping the [Night tariff setting] on the [Administrator settings] menu screen, the [Night tariff setting] screen is displayed.

If changing [Start time] or [End time] displayed, tap **Change** button.

If the power consumption in day time and in night time is not distinguished, tap **Set** button and after tapping **Valid** button to switch it to **Invalid**, tap **Set** button.

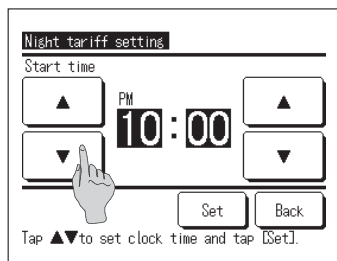

2. Set the [Start time] of [Night tariff setting].


Adjust the [Start time] to the desired time (at 10 min intervals) by tapping **▲** **▼** buttons.

After adjusting [Start time], tap **Set** button. The [End time] setting screen is displayed.

Adjust the [End time] to the desired time (at 10 min intervals) and **Set** button.

■ How to select the HP unit displayed on RC

The heat pump unit to display its operation state on the TOP screen is selectable.

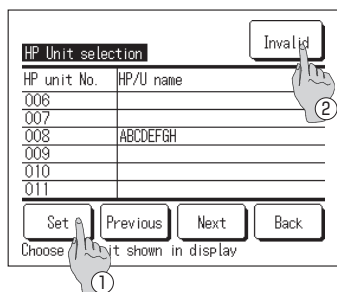

1. When tapping the [HP unit selection] on the [Administrator settings] menu screen, the [HP unit selection] screen is displayed.

If change the HP unit displayed on RC, select the HP unit to be displayed and tap ① **Set** button.

If not selecting the HP unit displayed on RC, tap ② **Valid** button and switch to **Invalid**. After that, tap ① **Set** button.

In case of **Invalid** setting, the HP unit to be displayed is selected automatically.

On the [HP unit selection] screen, up to 5 units can be displayed. If more than 6 units are connected to one remote control, when tapping **Next** button, the 6th and the subsequence HP units are displayed.

■ How to set remote control display

The display contents of remote control can be set

R/C display setting

Name of R/C

Name of HP Unit

Defrost operation display

Status of HW amount

Back

Select the item.

1. When tapping the [RC display setting] on the [Administrator settings] menu screen, the [RC display setting] menu screen is displayed.

- ① Name of RC ...Set the name of RC
(➡ Go to 2)
- ② Name of HP unit ...Set the name of HP unit
(➡ Go to 3)
- ③ Defrost operation display ...Set to display [In operation for defrosting] or not
(➡ Go to 4)
- ④ Status of HW amount ...Set to display [Status of HW amount] or not
(➡ Go to 5)

Name of R/C

Set

Alphabet Number

A	B	C	D	E	F	G	H	I
J	K	L	M	N	O	P	Q	R

Delete Next Back

Input the name and tap [Set].

2. Set the [Name of RC] displayed on the TOP screen.
Name of RC can be set with up to 9 2-byte letters
(18 1-byte letters)

It can use alphabet or numeric letter. When each button is tapped, allowable letters to be entered are displayed.

Select letters to be input one by one on the screen.
Tap **Back** **Next** button to display next candidate.

When the **Delete** button is tapped, selected letters are deleted one by one.

When the input is over, tap **Set** button. The name of RC is set and displayed on the TOP screen.

■ Operation method of various setting

Select heat pump unit

000	001 ROOM01	002	003
004	005	006	007

Next Back

Select the number of heat pumps

- Set the name of HP unit to be added to the **HP unit No.** button.

Tap the **HP unit No.** button to which the name is set.

When the letter selection screen is displayed same as at the setting of the name of RC (Go to 2), enter letters.

The name of HP unit can be entered up to 4 2-byte (8 1-byte) letters.

When the input is over, tap **Set** button.

Name of HP Unit

Set

Alphabet Number

A	B	C	D	E	F	G	H	I
J	K	L	M	N	O	P	Q	R

Delete Next Back

Input the name and tap [Set].

- Set the message of [In operation for defrosting] to be displayed or not.

When the operating conditions is to start frosting on the HP unit during its operation, it is controlled to operate defrosting automatically.

Defrost operation display

Display


Hide

Back

Select setting

Display...During defrosting operation, the message of [In operation for defrosting] is displayed.

Hide ...The message of [In operation for defrosting] is not displayed.

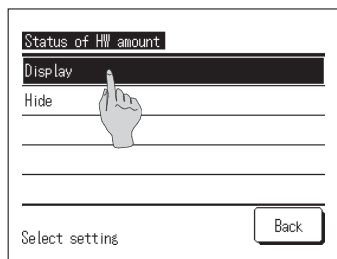

5. Set the icon for the [Status of HW amount] to be displayed or not.

If the hot water amount does not reach to the set amount, the icon for the [Status of HW amount] is displayed.

Display...If the hot water amount does not reach to the set amount, the icon [🚿] is displayed on RC.


Hide ...[🚿] is not displayed on RC.

The conditions to display the icon for the [Status of HW amount]


If the hot water is not stored up to the maximum of the set HW amount in one day operation pattern, it judges that there is some possibility not to store the hot water according to the schedule and display the icon for the [Status of HW amount].

If the icon is lit all the times, please check whether the relation between the HW storage operation pattern and HW usage pattern is OK or not.

(Ex.1) At normal *In case that the actual HW amount reaches to the set amount.

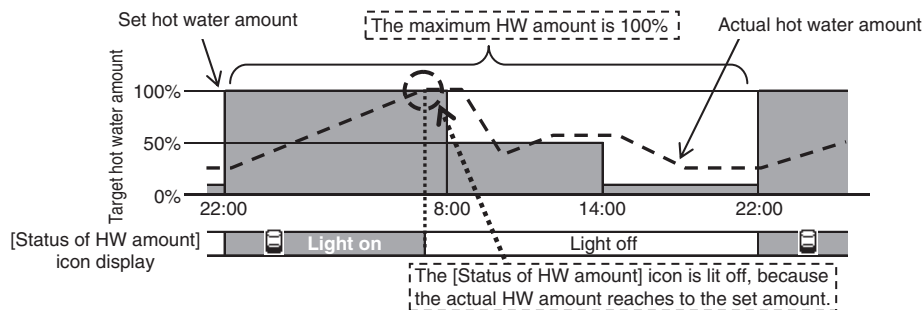


(Ex.2) When the icon is displayed *In case that the actual HW amount cannot reach to the set amount.

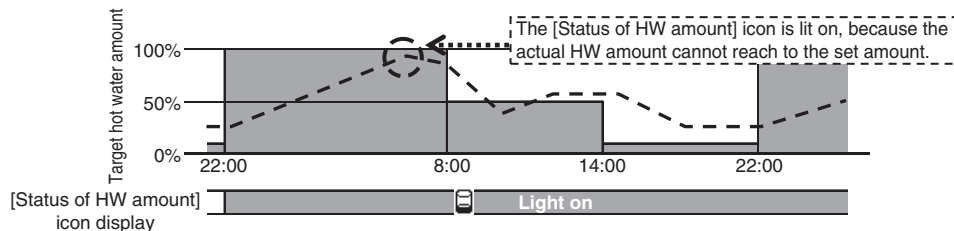

■ Operation method of various setting

■ How to change the step sized of HW temp.

The step size of the hot water temp can be changed.

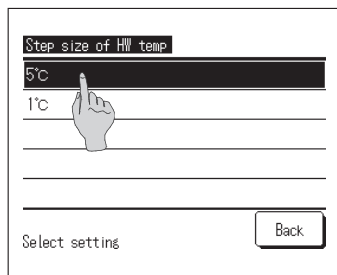

1. When tapping the [Step size of HW temp] on the [Administrator settings menu screen, the [Step size of HW temp] menu screen is displayed.

Please tap a desired step size.

5°C ...The step size of HW temp can be set at 5°C intervals


60°C⇔65°C⇔ ... ⇔85°C⇔90°C

1°C ...The step size of HW temp can be set at 1°C intervals

60°C⇔61°C⇔ ... ⇔89°C⇔90°C

■ How to change the Administrator password.

The Administrator password can be changed.

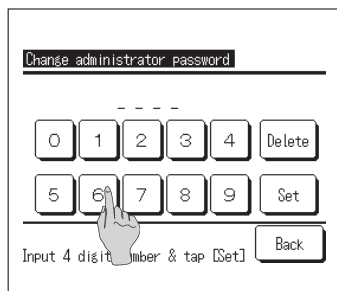

1. When tapping the [Change administrator password] on the [Administrator settings] menu screen, the [Change administrator password] screen is displayed.


Enter the password (4-digit number) and tap **Set** button.



2. [Change administrator password] confirmation screen is displayed for 3sec and it returns to the [Administrator setting] menu screen.


■ How to set the User environment

By selecting the typical operation pattern of business type, the detailed operation pattern can be set easily.



1. When tapping the [User environment] on the [Administrator settings] menu screen, the [User environment] menu screen is displayed.


Please select the business type whose operation pattern is similar to the target hot water temp of each time zone to be set.

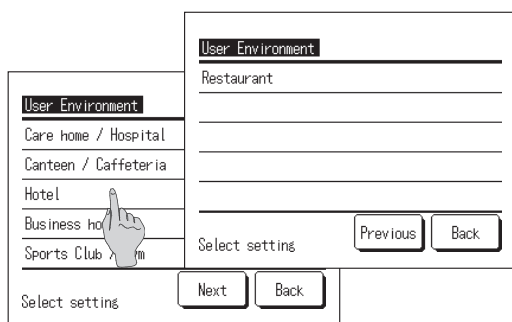

- ① Care home/hospital
- ② Canteen/Caffeteria
- ③ Restaurant
- ④ Hotel
- ⑤ Business hotel
- ⑥ Sports club/gym

Target water level for the business model

Time	Default value	Care home/hospital	Canteen/Caffeteria	Restaurant	Hotel	Business hotel	Sports club/gym
22:00	100%	60%	60%	60%	40%	40%	40%
0:00	100%	100%	100%	100%	100%	100%	100%
4:00	100%	100%	100%	100%	100%	100%	100%
8:00	30%	80%	80%	80%	80%	40%	100%
10:00	30%	50%	60%	80%	70%	40%	80%
13:00	30%	30%	40%	60%	60%	100%	60%
16:00	30%	30%	20%	40%	50%	100%	40%
19:00	30%	30%	20%	30%	40%	40%	30%



2. When tapping the business type on the [User environment] menu screen, the [User environment] acknowledge screen is displayed.

When tapping **Yes**, the time zone and the hot water amount of selected business type is saved as the operation pattern to be set.


After saving, the [Setting of weekly operation pattern] selection screen is displayed.

(☞ Go to 4 on Page 24)

Operation method of various setting

How to check the remote control setting

A setting list for the current setting of remote control and heat pump unit can be checked.

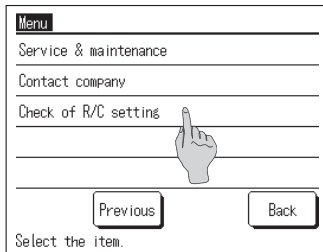

Menu

Service & maintenance


Contact company

Check of R/C setting

Previous Back

Select the item.

1. Tap the [Check of RC setting] on the menu screen.

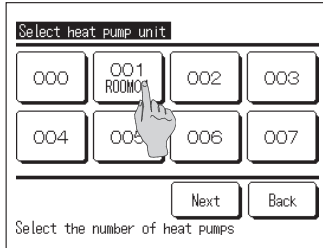

Select heat pump unit

000 001 ROOM 002 003


004 005 006 007

Next Back

Select the number of heat pumps

2. If multiple heat pump units are connected to the remote control, a list of all heat pump unit connected. Tap the HP unit to be displayed.

On the [Select heat pump unit] screen, up to 8 units are displayed. If 9 or more units are connected, when tapping **Next** button, the 9th and the subsequent units are displayed.

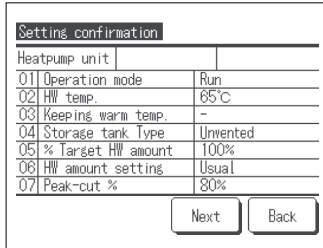


Settings confirmation

Heatpump unit

01	Operation mode	Run
02	HW temp.	65°C
03	Keeping warm temp.	-
04	Storage tank Type	Unvented
05	% Target HW amount	100%
06	HW amount setting	Usual
07	Peak-cut %	80%

Next Back

3. Since the current setting contents are displayed, the final check of settings can be done.

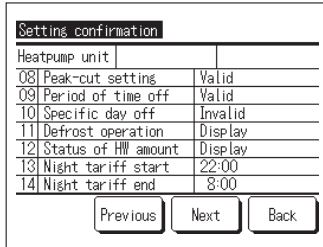

Settings confirmation


Heatpump unit

08	Peak-cut setting	Valid
09	Period of time off	Valid
10	Specific day off	Invalid
11	Defrost operation	Display
12	Status of HW amount	Display
13	Night tariff start	22:00
14	Night tariff end	8:00

Previous Next Back

Displayed item

No.	Item	Set range
1	Operation mode	Run/Stop/Pause
2	Hot water temp	From 60°C to 90°C
3	—	Out of USE
4	Storage tank Type	Unvented/Open
5	% Target HW amount	From 10% to 100%
6	HW amount setting	Usual/More/Less
7	Peak-cut %	0, 40, 60, 80%
8	Peak-cut setting	Valid/Invalid
9	Period of time off	Valid/Invalid
10	Specific day off	Valid/Invalid
11	Defrosting operation	Display/Hide
12	Status of HW amount	Display/Hide
13	Night tariff start	From 00:00 up to 23:50
14	Night tariff end	From 00:00 up to 23:50
15	Next service date	Day/Month/Year

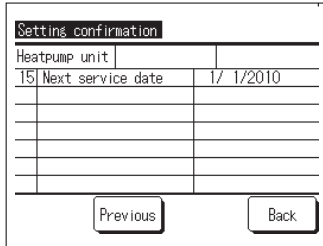

Settings confirmation

Heatpump unit

15	Next service date	1/ 1/2010

Previous Back

■ For maintenance

Maintenance of remote control

- Maintenance of LCD and main body of remote control.

When the surface of LCD or main body becomes dirty, wipe it with a dry soft cloth. If the dirt on the surface cannot be removed, soak the cloth in neutral detergent diluted with water, squeeze the cloth tightly, and clean the surface. And then wipe the surface with a dry cloth.

Request

Do not use any paint thinner, organic solvent, or strong acid.

WARNING

Do not use flammable materials (e.g. hairspray or insecticide) near the remote control.

Do not clean the remote control with benzene or paint thinner.

It may cause crack damage to the remote control, electric shocks or fire.



Maintenance of heat pump unit

- Secure the air circulation of heat pump unit

Since the heat pump unit retrieve heat from the air, much air is needed to suck. If blocking the air way to the inlet air port or from the outlet air port of heat pump unit or put something to block the air inlet way around the unit, it may cause decreasing capacity or malfunction.

- Washing the air to refrigerant heat exchanger

When using the unit for long period, the air to refrigerant heat exchange becomes dirty and it cannot operate properly.

Regarding the washing method, please consult with the dealer where you purchased.

- Cleaning the water circuit

Please clean the strainer in the water circuit periodically.

Maintenance of hot water storage unit (Unvented cylinder)

Regarding the maintenance of hot water storage unit, please refer to the instruction manual attached to the hot water storage unit.

■ For maintenance

Measure for anti-freezing water in winter

If the ambient temperature around the unit becomes below 0°C, the water pipe may freeze and it may cause damage of the heat pump unit.

Please consult with the dealer and be sure to take proper measure for anti-freezing. And if the water may freeze, please keep the power on supplying to the unit, even if the unit is pausing, because the heat pump unit may start operation for anti-freezing.

When stopping the unit for long period.

If you do not use the unit for more than one month, shut the main power off and drain off from the heat pump unit and the hot water storage unit as well.

The method for draining off, please consult with the installer or the dealer.

Request

When draining off, please shut off the power in advance according to the following procedure.

① Stop the heat pump unit

Select the [Service & Maintenance] on the menu screen and select the [System off] on the [Service & maintenance] menu screen.

* The service password is required.

② Shut off the power breaker of the heat pump unit and hot water storage unit.

When power failure occurs

If power failure occurs and water may freeze, shut off the main power and drain off from the heat pump unit and the hot water storage unit as well.

CAUTION

If shutting the power breaker off during operation of the heat pump unit, it may cause malfunction of the heat pump unit

■ When error happens

However, please note the following cases are not anomaly.

The cases that are not anomaly

Q The heat pump unit repeats Run and Stop

A During hot water storage operation, if the outdoor air temp is rather low, the HP unit repeats Run and Stop due to defrost operation.

During standby, if the outdoor air temp is below 5°C the water pump built in the HP unit repeats Run and Stop in order to prevent water in the HP unit and piping from freezing.

And during standby, the fan of the air to refrigerant heat exchanger on the HP unit repeats Run and Stop depending on the SW setting in order to prevent snow from accumulating on the fan. (SW setting is required)

Q During hot water storage operation, the surface of the air to refrigerant heat exchanger becomes white with frost.

A If the outdoor air temp is rather low, the surface of the air to refrigerant heat exchanger may be covered with frost during operation.

Q During hot water storage operation, water comes out from the HP unit.

A When the HP unit retrieve heat from the air, dew condensation comes out. And if the outdoor air temp is rather low, much water comes out due to melting frost by defrost operation.

Q Hot water does not come out

A If no hot water or no water comes out, water in the pipe may be frozen. Please consult with the dealer where you purchased.

If only water (not hot water) comes out, it is the states that hot water is not stored in the cylinder.

Please start operation to top up or to fill up and store hot water in the cylinder.

Q Hot water amount is decreasing despite no usage of hot water.


A The display of hot water amount shows the hot water amount in the cylinder whose temp is about 50°C or higher.

If hot water does not be used for a long period of time, hot water in the cylinder becomes colder due to natural heat dissipation so that the display of hot water amount becomes decreasing.

When error happens


If error happens on the heat pump unit, [Under protection stopping] is displayed at the message display section.

Please do following procedures and stop operation. And inform to the dealer where you purchased.

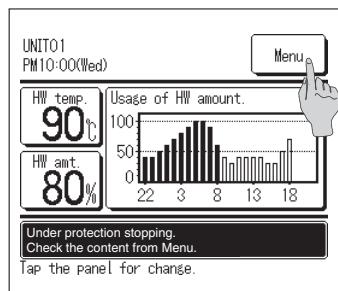


1. The message of [Under protection stopping] is displayed at the message display section.

Tap **Menu** button.

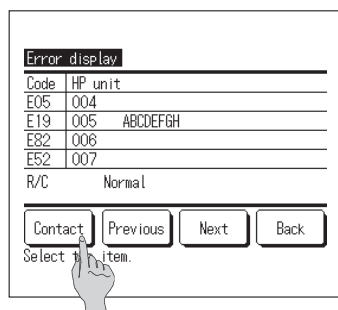

2. Error code is displayed on the [Error display] screen.

Check the error code and tap **Contact** button

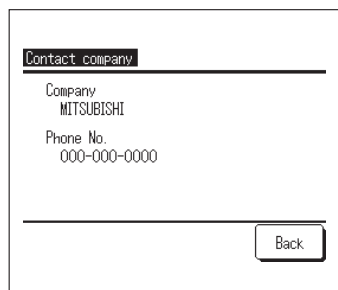

3. [Contact company] screen is displayed (Company name and Phone No.)
If it was input in advance, it can be displayed.

When error happens

A list of error code

Remote controller Error code	LED on heat pump unit		7-segment display	Contents of inspection
	Green	Red		
No display	Keep flashing	Stay off	Normal	Power line anomaly No display
E1	Keep flashing	Stay off	Normal	Communication error between remote controller and heat pump unit
E10	Keep flashing	Stay off	Normal	Excessive connected number of heat pump units to the remote controller
E31	Keep flashing	1-time flash	E31	Duplicated address No. of heat pump unit Address setting error of heat pump unit
E32	Keep flashing	1-time flash	E32	Open phase on power source Reverse phase on power source
E36	Keep flashing	1-time flash	E36-1	Discharge pipe temperature anomaly (Tho-D1)
E37	Keep flashing	1-time flash	E37-1	Heat exchanger temp. sensor 1 fault (Tho-R1)
		2-time flash	E37-2	Heat exchanger temp. sensor 2 fault (Tho-R2)
		3-time flash	E37-3	Heat exchanger temp. sensor 3 fault (Tho-R3)
		4-time flash	E37-4	Heat exchanger temp. sensor 4 fault (Tho-R4)
		5-time flash	E37-5	Fault of inlet water temp. sensor 1 on gas cooler (Tho-W1)
		6-time flash	E37-6	Fault of outlet water temp. sensor 2 on gas cooler (Tho-W2)
		Keep flashing	E37-7	Fault of inlet gas temp. sensor 1 on gas cooler (Tho-G1)
			E37-9	Fault of outlet gas temp. sensor 3 on gas cooler (Tho-G3)
E38	Keep flashing	1-time flash	E38	Outdoor air temp. sensor fault (Tho-A)
E39	Keep flashing	1-time flash	E39-1	Discharge pipe temp. sensor fault (Tho-D1)
		3-time flash	E39-3	Fault of inlet temp. sensor 1 on intermediate receiver (Tho-M1)
E40	Keep flashing	1-time flash	E40	High pressure anomaly (HP switch 63H1-1 activated)
E41	Keep flashing	1-time flash	E41-1	Power transistor overheat (for CM1) (5 times within 60 minutes)
E42	Keep flashing	1-time flash	E42-1	Current cut (for CM1)
E45	Keep flashing	1-time flash	E45-1	Communication error between inverter PCB and control PCB (CM1) High pressure anomaly (HP switch 63H1-1 activated)
E48	Keep flashing	1-time flash	E48-1	Outdoor fan motor 1 anomaly (FMo1)
		2-time flash	E48-2	Outdoor fan motor 2 anomaly (FMo2)
E49	Keep flashing	1-time flash	E49-1	Low pressure anomaly (LP sensor PSL1 activated)
E51	Keep flashing	1-time flash	E51-1	Power transistor 1 overheat (for CM1) (15 minutes continuously)
E52	Keep flashing	1-time flash	E52-1	Fault of hot water temp. sensor 1 on unvented cylinder (ThT-1)
		2-time flash	E52-2	Fault of hot water temp. sensor 2 on unvented cylinder (ThT-2)
		3-time flash	E52-3	Fault of hot water temp. sensor 3 on unvented cylinder (ThT-3)
		4-time flash	E52-4	Fault of hot water temp. sensor 4 on unvented cylinder (ThT-4)
		5-time flash	E52-5	Fault of hot water temp. sensor 5 on unvented cylinder (ThT-5)
		6-time flash	E52-6	Fault of hot water temp. sensor 6 on unvented cylinder (ThT-6)
		Keep flashing	E52-7	Fault of hot water temp. sensor 7 on unvented cylinder (ThT-7)
			E52-8	Fault of hot water temp. sensor 8 on unvented cylinder (ThT-8)
			E52-9	Fault of hot water temp. sensor 9 on unvented cylinder (ThT-9)
E53	Keep flashing	1-time flash	E53-1	Suction pipe temp. sensor 1 fault (Tho-S1)
		3-time flash	E53-3	Injection inlet temp sensor 1 fault (Tho-inj1)
E54	Keep flashing	1-time flash	E54-1	Disconnection of low pressure sensor 1(PSL) Anomalous output of low pressure sensor 1
		2-time flash	E54-2	Disconnection of high pressure sensor 1(PSH) Anomalous output of high pressure sensor 1
		3-time flash	E54-3	Disconnection of intermediate pressure sensor 1(PSM) Anomalous output of intermediate pressure sensor 1
E55	Keep flashing	1-time flash	E55-1	Under-dome temp. sensor 1 fault (Tho-C1)
E56	Keep flashing	1-time flash	E56-1	Power transistor temp. sensor 1 fault (Tho-P1)
E58	Keep flashing	1-time flash	E58-1	Compressor anomaly by loss of synchronism (CM1)
E59	Keep flashing	1-time flash	E59-1	Compressor start-up failure (CM1)

A list of error code (Continue)

Remote controller Error code	LED on heat source unit		7-segment display	Contents of inspection
	Green	Red		
E61	Keep flashing	1-time flash	E61-1	Communication error between master unit and slave unit 1
		2-time flash	E61-2	Communication error between master unit and slave unit 2
		3-time flash	E61-3	Communication error between master unit and slave unit 3
E63	Keep flashing	1-time flash	E63	Emergency stop , AF anomaly (set at adding active filter)
E64	Keep flashing	1-time flash	E64	Water pump anomaly (no operation)
				Water pump anomaly (excessive operation)
E89	Keep flashing	1-time flash	E89	Communication error between control PCB and CPU
No hot water comes out (1)	Keeps flashing	Stays off	Normally	See troubleshooting
No hot water comes out (2)	Keeps flashing	Stays off	Normally	See troubleshooting
No hot water comes out (3)	Keeps flashing	Stays off	Normally	See troubleshooting
Anomalous sound and vibration (1)	Keeps flashing	Stays off	Normally	See troubleshooting
Anomalous sound and vibration (2)	Keeps flashing	Stays off	Normally	See troubleshooting


Maintenance code

Maintenance code is the signal for prompt service and maintenance, not to show anomaly.

7-segment display No.	RC display No.	Items	Remarks
Compressor operation hours			
oPE-1	M1	<In case that SW6-8 is OFF> When the cumulative operation hours of compressor has elapsed 5,000hr since the last maintenance, and it is between 4,900hr and 5,100hr. <In case that SW6-8 is ON> When the cumulative operation hours of compressor has elapsed 2,000hr since the last maintenance, and it is between 1,900hr and 2,100hr.	Synchronizing with the timing of alarming by the simple remote monitoring equipment
oPE-2	M2	<In case that SW6-8 is OFF> When the cumulative operation hours of compressor has elapsed 10,000hr since the last maintenance. <In case that SW6-8 is ON> When the cumulative operation hours of compressor has elapsed 5,000hr since the last maintenance	
oPE-3	M3	When the cumulative operation hours of compressor has elapsed 30,000hr since the last maintenance.	
Water pump operation hours			
oPE-11	M11	When the cumulative operation hours of water pump has elapsed 5,000hr since the last maintenance, and it is between 4,900hr and 5,100hr.	Synchronizing with the timing of alarming by the simple remote monitoring equipment
oPE-12	M12	When the cumulative operation hours of water pump has elapsed 10,000hr since the last maintenance.	
oPE-13	M13	When the cumulative operation hours of water pump has elapsed 20,000hr since the last maintenance.	
Setting error			
oPE-20	M20	Setting error for type of cylinder	Check setting of SW3-3 is OFF for unvented cylinder
oPE-21	M21	Setting error of heat pump unit model	Kept SW4-1, -2, -3, -4 "OFF" (Factory default)
oPE-22	M22	Setting error of master/slave units	Check setting of SW4-7 and -8
Error information			
oPE-30	M30	Detection of AF error	But E63 is not displayed
oPE-32	M32	Detection of drying up water	It is always displayed at test run
oPE-33	M33	Detection of disconnection of cylinder water temp sensor	
oPE-34	M34	Detection of suspension of water supply	
oPE-35	M35	Detection of water pump error	

Contact company

From the menu screen, the service contact can be seen.

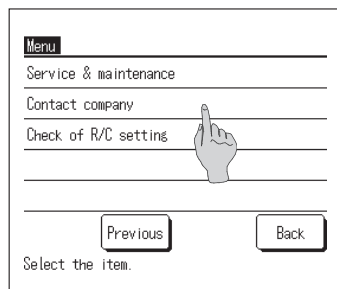


1. Please tap [Contact company] on the menu screen.

Next service date


If the setting of [Next service date] was done on the [Service & Maintenance] menu, the following screen is displayed for 5sec at starting operation and for 20sec at ending operation.

And when the [Next service date] has passed by, the icon [🔔] is displayed on the TOP screen.

If the [Next service date] is coming or the icon [🔔] is displayed, please contact to the contact company displayed on RC or the dealer where you purchased.

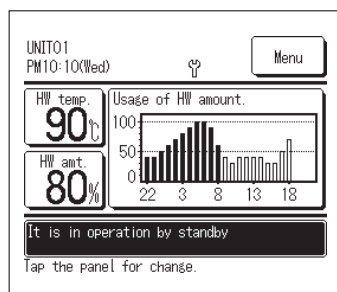

When the [Next service date] has passed by, the icon [🔔] is displayed on the TOP screen.

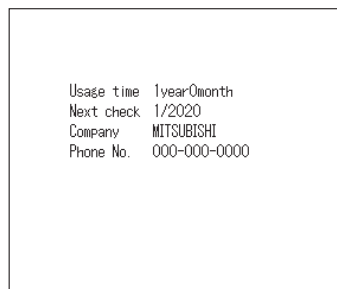


If the [Next service date] was set, the screen at left is displayed at starting operation or ending operation.

■ When [Periodical check] is displayed

When [Periodical check 1] or [Periodical check 2] is displayed

In order to inform the periodical inspection period of heat pump unit, [Periodical check 1] or [Periodical check 2] may be displayed at the message section of the TOP screen.

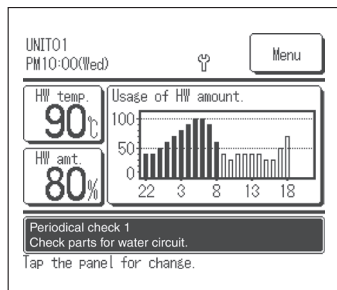

If the following display of periodical check is displayed, please ask periodical check to the contact company displayed on the [Contact company] screen or the dealer where you purchased.

- Periodical check 1 Please do periodical check of the parts for water circuit.
- Periodical check 2 Please do periodical check of the parts for refrigerant circuit.

■ If keeping on using without doing emergency check, it may cause damage of the heat pump unit.

■ After-sales service.

● Inform your dealer

- Model name
- Date of installation
- Failure conditions: As precise as possible.
- Your address, name, and telephone number

● Moving

The Moving of the unit requires special technology. Consult your dealer. Necessary expenses for the moving of the unit will be charged.

● Repairs after Warranty Period

Consult your dealer. Fare-paying services may be possible at the request of customer.

● Inquiry about After-sale Service

Contact your dealer or the service contact.

Specifications

Item		Model	ESA30E-25
Power supply			3-phase 380V $\pm 5\%$ / 400V $\pm 5\%$ / 415V $\pm 5\%$ 50Hz
Operation to top up (In intermediate season) *1	Heating capacity	kW	30
	Water amount	Liter/min	8.97
	Power consumption	kW	6.98
	COP	—	4.3
Operation to top up (In cold region) *2	Heating capacity	kW	30
	Water amount	Liter/min	5.06
	Power consumption	kW	10.73
	COP	—	2.8
Operating sound *3		dB(A)	58
Outside dimension	Height	mm	1,690
	Width	mm	1,350
	Depth	mm	720 + 35 (Water pipe connection)
Current	Max	A	21
	Starting	A	5
Unit weight		kg	375 (During operation 385)
Retained water amount		L	10
Color			Stucco white (4.2Y7.5/1.1 approx.)
Compressor	Type x Pcs		Hermetic inverter compressor x 1
	Nominal output	kW	6.4
Refrigerant	Type		R744 (CO2)
	Charged amount	kg	8.5
Refrigerant oil	Type		MA68
	Charged volume	cc	1200
Crankcase heater		W	20
Anti-freezing heater	for water pipe	W	48 x 3
	for drain pan	W	40 x 2
	for drain hose	W	40 x 2 + 48
Heat exchanger, Air side			Copper pipe straight fin type
Heat exchanger, Water side (Gas cooler)			Copper pipe coil type
Fan	Type		Axial flow type (direct coupled motor) x 2
	Output x Pcs	W	386 x 2
	Air volume	m ³ /min	260
Water pump	Type x output		Non-self-suction spiral type inverter pump x 100W
	Materials contacting to water		Bronze, SCS13
	Actual pump head	m (kPa)	5m (49kPa) @ 17Liter/min
Usage temp range	Outdoor air temp	°C	-25 to +43
	Feed water inlet temp	°C	5-63
	Hot water outlet temp	°C	60-90
Water pressure range		kPa	500 or lower
Defrost			Hot gas type
Vibration and sound proofing devices			Compressor: placed on anti-vibration rubber and wrapped with sound insulation
Protection devices			High pressure switch, over current protection, power transistor overheat protection and anomalous high pressure protection
Pipe size	Feed water inlet		Rc3/4 (Copper 20A)
	Hot water outlet		Rc3/4 (Copper 20A)
	Drain water outlet		Rc3/4 (Copper 20A)
Electric wiring	Earth leakage breaker		30A, 30mA, 0.1sec
	Power cable size		□14 x 4 (Length 40m)
	Moulded-case circuit breaker		Rated current: 30A, switch capacity: 30A
	Grounding wire size		M6
Design pressure	Remote controller wire size		0.3mm ² x 2cores shielding wire (MVVS)
		MPa	High pressure: 14.0, Low pressure: 8.5
IP code			IP24

(Note)

- Performance of operation to top up in intermediate season shows the capacity measured under the conditions that outdoor air temp is 16°C DB/12°C WB, water inlet temp is 17°C and hot water outlet temp is 65°C.
- Performance of operation to top up in cold region shows the capacity measured under the conditions that outdoor air temp is -7°C DB/-8°C WB, water inlet temp is 5°C and hot water outlet temp is 90°C excluding heater for anti-freezing water (345W).
- Operating sound shows a value measured at 1m in front of the unit and 1m above the floor in anechoic room where the sound is resonated a little. Accordingly if the unit is installed on actual site, it is normal that the measured sound there is higher than the value shown above, because it is influenced by surrounding noise and echo in the room.
- The actual hot water outlet temp may vary $\pm 3^\circ\text{C}$ from target temp according to the change of outdoor air temp and water inlet temp. And then if feed water inlet temp is 30°C or higher and outdoor air temp is 25°C or higher, hot water outlet temp may be controlled not to increase too high.
- Please use the clean water. The water quality should follow a guideline of JRA-GL. 02:1994.
If the water quality is out of the standard, it may cause troubles such as scale buildup and/or corrosion.
- These articles mentioned above may vary without any notice according to the development status.

Fixing heat pump unit

Anchor bolt	M10 x 4
According to the installation conditions, please take a measure to prevent from falling, cross wind and heavy snow.	

EC DECLARATION OF CONFORMITY

We **MITSUBISHI HEAVY INDUSTRIES, LTD.**
AIR-CONDITIONING & REFRIGERATION DIVISION
3-1, Asahi, Nishibiwajima-cho, Kiyosu,
Aichi, 452-8561, JAPAN

declare under our sole responsibility that the apparatus

Description of apparatus: Heat Pump Water Heater
Model name: ESA30E Series

referred to in this declaration conforms with the following directives.

Relevant EC Directives :

Machinery Directive 2006/42/EC

Applied Standards :

EN 378-2

EN 60335-1

EN 60335-2-40

Authorized representative in EU :

MITSUBISHI HEAVY INDUSTRIES AIR-CONDITIONING EUROPE, LTD.
7 Roundwood Avenue, Stockley Park, Uxbridge, Middlesex, UB11 1AX, United Kingdom

Note : About the detail of Conformity model, see EC DECLARATION OF CONFORMITY sheet
included in a package

 **MITSUBISHI HEAVY INDUSTRIES, LTD.**



mitsubishi heavy industries, ltd.

AIR-CONDITIONING & REFRIGERATION DIVISION

3-1, Asahi, Nishibiwajima-cho, Kiyosu, Aichi, 452-8561, Japan
<http://www.mhi.co.jp>

mitsubishi heavy industries air-conditioning europe, ltd.

7 Roundwood Avenue, Stockley Park, Uxbridge, Middlesex, UB11 1AX, United Kingdom
Tel : +44-20-7025-2750
Fax : +44-20-7025-2751
<http://www.mhia.com>